



2019

Innovation

Quality

* Service

Refrigeration Parts and Equipment Catalog

INDEX


2019 Catalog

ACCUMULATORS27
ACCUMULATOR - DRIERS27
CAPILLARY ASSEMBLIES
Strainer30
Strainer-Drier29
CONDENSERS (WATER COOLED)
Coaxial19
Shell & Coil18
DRIERS
Big R28
Junior29
Filter25
Universal28
FITTINGS (Rotalock)14, 15, 16, 17
FUSIBLE PLUGS7
HEAT EXCHANGERS
Blue Ribbon (Subcooling)21
Deluxe (Subcooling)21
Desuperheating20
Double Wall Cleanable Desuperheating 19
Liquid to Liquid22
Shell & Coil Type Condensers18
HEAT PUMP
Suction Accumulators
Water Cooled Condensers18, 19
MANIFOLDS27
MUFFLERS (Discharge)
Adjustable11
Higher Pressure10,11
Non-Adjustable10

MUFFLERS (Suction)32
OIL RESERVOIRS22
OIL SEPARATORS23
OIL SEPARATORS FOR 410A23
OIL STRAINERS22
RECEIVERS
ASME15
R410A ASME17
Conventional 12, 13
For Rotalock Fittings14, 15, 16, 17, 18
Higher Pressure16
Big Dog Receiver Driers18
SIGHT GLASSES 12
SPECIAL O.E.M. PARTS24
STRAINERS
Capillary31
Liquid Line26
Water26
Strainer Elements31
Cartridge or Pencil31
SUCTION ACCUMULATORS
Heat Pump6, 7
Commercial 1, 2, 3
No Sweat-No Frost9
ASME 410A8
SUCTION ACCUMULATOR HEAT EXCHANGER
COMBINATIONS4, 5
TUBING
Capillary30
VALVES (Rotalock) 14, 15, 16, 17

· Research · Design · Quality · Value · Service · Experience ·

Engineering departments look to Refrigeration Research for assistance in design of component parts and procurement of test samples. We always strive to improve quality and reduce cost through engineering and manufacturing advancements. Contact us for your special needs or assistance.



RESEARCH

525 North Fifth Street • P.O. Box 869 Brighton, Michigan 48116

Phone: (810) 227-1151 FAX: (810) 227-3700

WEBSITE: www.refresearch.com

The ORIGINAL, TIME TESTED

SUCTION ACCUMULATOR

- - THE COMPLETE LINE - -For Exact Selection

Air conditioning, heat pump, truck refrigeration and many other applications require intermittent operation of the refrigeration compressor. Especially in remote applications, the suction line may trap or hold quantities of liquid which are suddenly dumped into the compressor as it starts up. This is frequently the cause of broken valves, pistons, broken or bent connecting rods, blown gaskets and bearing washout.

installation of the Proper Refrigeration Research suction accumulator in the suction line. just before the compressor, eliminates damage. If correctly sized, relatively large quantities of liquid refrigerant may return through the suction line METERING ORIFICE and the suction accumulator prevents damage to the compressor. Liquid is temporarily held in the suction accumulator and metered back to the compressor along with any oil, at a controlled rate,

COMPRESSOR COIL METAL PLATE PATENTED INLET DEFLECTOR 3680 3816 3670 Will Not 3684 3817 3732 Trap Oil 3685 3701 3734 3689 3702 3827 3703 3732 3738 **Protects** 3736 3731 3700 the 3837 3733 3706 Compressor 3737 3698 3704 3743 3707 3832 3708 3826 3831 "LEEK PRUF" FUSIBLE PLUG 3836 INSTALLED, TESTED 3810 AND REMOTE SECURE, STABLE BASE MOUNTING. FROM LINE 3838 STUD COPPER BRAZED IN ADDITION CONNECTIONS. TO SPOT WELD. 3839

through the metering orifice. Therefore, damage to the compressor is prevented and the compressor immediately and quietly goes to work. ASME code models below

THE ORIGINAL, YET IMPROVED, SUCTION ACCUMULATOR BY REFRIGERATION RESEARCH PROVIDES ALL OF THE IMPORTANT FEATURES.

- 1. Exclusive (patented) inlet deflector for improved performance. Deflector permits tangential entry of fluid.
- 2. Marking of inlet with a metal plate is an exclusive feature and helps prevent errors in hook up.
- 3. All Refrigeration Research suction accumulators of 4" through 6" diameter have tusible plugs included and installed to comply with latest (إلِ) and (إلِل) requirements.
- 4. Copper nipples are standard on vertical (VL) and (VL) models.
- 5. Controlled hydrogen copper brazing process provides the ultimate in cleanliness and uniform strength.
- 6. All Refrigeration Research suction accumulators are (إلِ) and ،(إلا) listed or built to ASME code, CE documentation also available. Suction accumulators by Refrigeration Research have been field proven in hundreds of thousands of installations.

SELECTION OF SUCTION ACCUMULATOR - The suction accumulator should not necessarily be selected to have the same size inlet and outlet as the compressor suction line. It is more important to select the suction accumulator well within the limits of (1) pressure drop, (2) oil return as shown on the following page and (3) total amount of charge

The actual refrigerant holding capacity needed for a suction accumulator is governed by the requirements of the particular application. There is a great variation in refrigeration systems and this must be considered. Where possible the capacity selected should be

These brackets can be used to hold horizontal accumulators securely in position.

checked by actual test. Normally the accumulator should not be sized for less than 50% of the total system capacity. If in doubt, consult the compressor manufacturer. Steel nipples are available on special order.



3639 3641

3640



3841 3873 3840 3874

Mounting Brackets

RR 7187 (8 5/8" Dia.)

RR 7188 (10 3/4" Dia.)

PATENTED NO. 5.076.313 AND PATENTS APPLIED FOR.



SUCTION ACCUMULATOR APPLICATION DATA

ЯЗ												_		+	+ RECOMMENDED TONS OF REFRIGERATION	NDED TON	S OF REFF	RIGERATIO	z	
amu	O JA:	ETER HES)	нтэ	THS	MAXIMU	MAXIMUM REFRIGERANT HOLDING	ERANT H	OLDING	\subseteq	SUCTION	SUCTION INLET/	T/ EVAP	_			REFRIGERANT	RANT			
JN TS		MAI: IDNI)	I TEN	MEI			(FD3.)) ह	OUTLE	OUTLET I.D. SIZE	ZE TEMP		R-410A	R-1	R-134a	R.	R-22	R-404a	4 a
₽Aq			#		R-410A	R-134a	R-22	R-404a	IDENT				MAX	N	MAX	MIN	MAX	NIN	MAX	Z
3680	۸	3.0	8.2	2.3	1.3	1.5	1.5	1.3	NH		_	+40°F	°F 0.94	0.17	0.45	0.11	06.0	0.16	0.80	0.13
3816	>	4.0	7.1	3.0	1.9	2.2	2.1	1.9	KN	_		+20°F	°F 0.65	0.15	0.31	0.09	0.62	0.14	0.58	0.10
3817	>	4.0	11.1	4.6	3.7	4.2	4.2	3.7	KN		1/2	0°F	F 0.47	0.11	0.22	0.08	0.45	0.11	0.40	0.08
3815	I	3.0	7.9	2.1	1.3	1.5	1.5	1.4	HN	_		-20°F	°F 0.31	0.09	0.13	90.0	0:30	0.09	0.25	90.0
3673	I	3.0	10.9	2.7	2.0	2.2	2.2	1.9	HN	,		-40°F	°F 0.19	0.07	0.08	0.04	0.18	0.07	0.14	0.05
3684	>	3.0	8.3	2.2	1.4	1.6	1.6	1.4	NH											
3701	>	4.0	7.1	3.0	1.9	2.2		1.9	KN			+40°F	°F 2.10	0.19	0.90	0.13	2.00	0.18	1.55	0.15
3689	>	3.0	10.8	2.8	1.9	2.2	2.2	1.9	HN		2/8	+20°F	°F 1.31	0.17	0.54	0.11	1.25	0.16	1.00	0.12
3685	>	3.0	12.6	3.1	2.4	2.7	2.7	2.4	HN		2	0°F	F 0.89	0.13	0.36	0.10	0.85	0.13	0.70	0.10
3702	>	4.0	11.1	4.6	3.6	4.2	4.1	3.6	KN	_		-20°F	°F 0.58	0.11	0.22	0.08	0.55	0.11	0.45	0.08
3820	I	3.0	7.9	2.4	0.8	1.5		1.4	HN			-40°F	°F 0.36	0.09	0.13	90.0	0.35	0.09	0.25	0.07
3821	I	3.0	11.8	3.0	2.1	2.4	2.4	2.1	HN			_								
												+40°F	°F 3.15	0.23	1.62	0.14	3.0	0.22	2.8	0.22
3703	>	4.0	11.4	5.2	3.5	4.1	4.0	3.7	KN	_		+20°F	°F 2.21	0.19	1.03	0.11	2.1	0.18	2.0	0.18
3731	>	5.0	10.2	0.9	5.5	6.2	6.1	5.3	DN		3/4	0°F	F 1.57	0.17	0.63	0.10	1.5	0.16	1.4	0.16
3733	>	5.0	12.7	7.7	6.9	8.0	7.9	6.9	DN		_	-20°F	°F 1.15	0.13	0.43	0.09	1.1	0.13	8.0	0.13
										•		-40°F	°F 0.60	0.10	0.25	0.06	0.6	0.10	0.5	0.10
3670	^	4.0	11.3	5.5	3.5	4.0	4.0	3.5	KN											
3732	^	5.0	10.5	0.9	5.5	6.2	6.1	5.3	EN			+40°F	°F 4.20	0.55	2.25	0.35	4.0	0.53	4.0	0.53
3738	>	5.0	13.2	7.7	7.0	8.0	7.9	6.9	EN			+20°F	°F 3.15	0.47	1.62	0.30	3.0	0.45	3.0	0.45
3734	>	5.0	14.8	8.7	8.0	9.0	8.9	7.8	EN		7/8	0°F	F 2.41	0.41	0.87	0.25	2.3	0.39	2.0	0.39
3710	>	5.0	18.0	11.0	9.0	10.2	10.1	8.8	EN		· —	-20°F	°F 1.57	0.34	0.63	0.20	1.5	0.33	1.3	0.33
3827	>	6.0	14.0	11.3	10.0	11.3	11.1	9.8	MΝ	`		-40°F	°F 0.94	0.28	0.36	0.16	0.9	0.27	0.7	0.27
3825	I	0.9	10.0	8.9	8.5	9.7	9.6	8.4	MΝ											
3826	I	6.0	13.5	12.0	11.7	13.3	13.1	11.6	MN											
3832	^	6.0	11.0	10.0	7.6	8.6	8.5	7.5	MN											
3735	>	5.0	15.6	8.7	8.0	9.0	8.9	7.8	DN			+40°F	°F 9.45	0.80	4.35	0.48	9.0	0.76	9.0	0.76
3736	>	5.0	19.1	10.5	10.1	11.3	11.1	9.8	DN	_		+20°F	°F 6.51	0.68	2.88	0.43	6.2	0.65	0.9	0.65
3700	>	6.0	15.0	13.0	11.5	13.1	12.9	11.4	MN		1-1/8	0°F	4.51	0.59	1.83	0.36	4.3	0.56	4.0	0.56
3707	>	6.0	18.1	14.5	14.4	16.3	16.1	14.2	MN	_		-20°F	°F 2.94	0.49	1.21	0.29	2.8	0.47	2.5	0.47
3830	ェ	6.0	13.5	11.3	13.2	15.0		13.0	NΜ)		-40°F	°F 1.89	0.39	0.78	0.15	1.8	0.38	1.4	0.38
3831	I	6.0	16.5	13.2	16.0	18.1	17.9	15.7	MΝ		\dashv	_							ı	7



3837	^	5.0	13.5	11.8	9.4	10.7	10.6	9.3	EN												
3737	Λ	5.0	18.5	10.5	10.1	11.3	11.1	9.8	DN				+40°F	17.80	2.10	7.20	1.35	17.0	2.0	15.0	2.0
3708	۸	0.9	15.0	13.0	11.5	13.1	12.9	11.4	MN	_			+20°F	11.50	2.00	5.40	1.16	11.0	1.9	10.0	1.9
3706	Λ	0.9	20.3	17.0	15.6	17.8	17.5	15.4	MN	_	1-3/8	<u></u> ✓	0°F	8.08	1.68	3.42	0.97	7.7	1.6	7.0	1.6
3743	Λ	0.9	24.8	18.0	20.1	22.9	22.6	19.9	MN				-20°F	5.25	1.36	2.16	0.87	5.0	1.3	4.5	1.3
3835	Н	6.0	13.5	11.5	13.2	15.0	14.8	13.0	MN	•		<u> </u>	-40°F	3.15	1.15	1.26	0.68	3.0	1.1	2.5	1.1
3836	Н	6.0	22.5	17.1	15.2	17.3	17.1	15.1	MN												
3698	Λ	0.9	17.1	14.4	12.6	14.4	14.2	12.5	MN			т	+40°F	29.40	2.10	11.70	1.35	28.0	2.0	25.0	2.0
3704	^	0.9	24.8	20.5	20.1	22.9	22.6	19.9	MN	_			+20°F	19.90	2.00	8.10	1.16	19.0	1.9	18.0	1.9
3809	Н	0.9	18.0	15.6	11.3	12.9	12.7	11.2	MN		1-5/8	□	0°F	13.60	1.68	5.40	0.97	13.0	1.6	12.0	1.6
3810	Н	0.9	30.0	22.0	19.0	21.6	21.3	18.8	MN				-20°F	8.40	1.36	3.60	0.87	8.0	1.3	7.0	1.3
										•		•	-40°F	5.25	1.15	1.80	0.68	5.0	1.1	4.0	1.1
													+40°F	61.90	5.09	28.8	3.57	59.0	5.8	55.0	5.8
3639	Λ	8-2/8	20.0	44.0	Δ	31.3	30.9	27.2	*	_			+20°F	Δ	Δ	18.9	3.09	41.0	5.2	39.0	5.2
3838	Н	0.9	36.0	28.0	27.5	31.3	30.9	27.2	MN	_	2-1/8	□	0°F	28.30	4.51	12.6	2.51	27.0	4.3	26.0	4.3
3839	Н	0.9	48.0	35.5	36.8	41.3	41.0	36.4	MN	_		_	-20°F	18.50	3.88	7.2	2.03	18.0	3.7	16.0	3.7
										,		<u>, </u>	-40°F	12.60	2.83	4.5	1.64	12.0	2.7	10.0	2.7
													+40°F	Δ	Δ	45.0	5.70	0.06	9.2	85.0	9.5
3641	^	10-3/4	20.0	57.0	Δ	51.4	50.7	44.7	*	_			+20°F	Δ	Δ	29.7	5.02	62.0	8.4	0.09	8.4
3841	Н	8-2/8	24.0	48.0	Δ	45.2	44.6	39.3	*	→	2-5/8	□	0°F	Δ	Δ	19.8	4.06	42.0	7.0	40.0	7.0
												_	-20°F	Δ	Δ	11.7	3.28	28.0	6.0	25.0	0.9
										,		,	-40°F	Δ	Δ	7.2	2.70	18.0	4.2	15.0	4.2
												-	+40°F	∇	Δ	63.0	99.6	130.0	15.0	125.0	15.0
3640	^	10-3/4	26.0	75.0	Δ	72.7	72.5	63.9	*	_			+20°F	Δ	Δ	48.6	8.40	0.06	13.0	0.06	13.0
3840	Н	10-3/4	24.0	63.0	Δ	71.3	70.4	62.0	*	_	3-1/8	□	0°F	Δ	Δ	33.3	6.57	0.09	11.0	0.09	11.0
3873	Н	10-3/4	48.0	114	Δ	151.5	149.5	131.7	*			<u> </u>	-20°F	Δ	Δ	20.7	5.89	40.0	9.3	40.0	9.3
3874	Н	10-3/4	0.09	120	Δ	191.6	189.1	166.5	*	,	\neg	,	-40°F	Δ	Δ	11.7	4.64	28.0	7.5	25.0	4.5

Suction Accumulators larger than 6" diameter are made to ASME Code. (Shielded arc welded construction) ASME # Length in inches includes nipples Suction Accumulators of 6" diameter or smaller are (up) and c (up) LISTED File No. SA2400 (Hydrogen copper brazed construction)

† Maximum and minimum recommended tons based on pressure drop and oil return through Suction Accumulators.

† Minimum recommended tons based on oil return through Suction Accumulators.

Δ These ASME models are not intended for use with R-410A refrigerant. See alternate line for R-410A ASME Models.

Electric float not available on HX models.

Suction Accumulators rated for 450 PSI (UL); 350 PSI (ASME)



Designed to do the Complete Job!

HEAT EXCHANGER— SUCTION ACCUMULATOR

Makes practical new design possibilities in refrigeration systems.

Development of the Heat Exchanger-Suction Accumulator as a refrigeration component by Refrigeration Research has resulted in new and practical designs and design possibilities in refrigeration systems.

As the result of the rapidly growing need, Refrigeration Research provides a Cataloged Heat Exchanger-Suction Accumulator to correspond to each of our most popular suction accumulators. The **Heat Exchanger-Suction Accumulator combinations** bear the same part number as the corresponding suction accumulators except that the letters HX have been added to indicate the presence of the heat exchanger coil. Other models are available on special order.

All Heat Exchanger-Suction Accumulators are complete with fusible plugs installed complying with latest (\$\frac{1}{2}L\) and \$\frac{1}{2}\text{\$\lambda\$}\text{ to ASME code. CE documentation available upon request.

Copper nipples are standard on vertical (VL) and ر(ابال) models. Steel nipples are standard on accumulators built to ASME code.

Steel nipples are available on vertical (VL) and د(الالـ) models on special order.

Application data is shown on the next page.



ASME CODE MODELS

HX3841 HX3840

MADE UNDER ONE OR MORE OF THE FOLLOWING PATENTS: NOS. 5,076,313; 5,075,967; 4,488,413; AND PATENTS APPLIED FOR.

in position.



HX3701 HX3702 HX3703 HX3738



HX3836 HX3810 HX3839

ASME CODE MODELS



HX3639 HX3641 HX3640

(SUCTION ACCUMULATORS ESPECIALLY DESIGNED FOR HEAT PUMPS ARE SHOWN ON PAGES 6 AND 7). PHOTOS FOR ILLUSTRATIVE PURPOSE ONLY - DO NOT USE AS A GUIDE FOR INSTALLATION.

Mounting Brackets RR 7187 (8 5/8" Dia.) RR 7188 (10 3/4" Dia.) These brackets can be used to hold horizontal

accumulators securely



4

APPLICATION DATA FOR HEAT EXCHANGER-SUCTION ACCUMULATOR COMBINATIONS

Suction Accumulators on this page are exactly the same as the corresponding numbers

on page 3 except that "HX" designates a Heat Exchanger Coil added.

					F	age 5	check			designates	, a ricat L	T									—
BER	AF.	ж _	_		MAN	MUM RE	EDIGED	ANT	(ŲL)						† REC	OMMEN	DED TO	NS OF RE	FRIGER	ATION	
PART NUMBER	VERTICAL OR HORIZONTAL	DIAMETER (INCHES)	LENGTH	WEIGHT		ING CAP			ID.	SUCTION	LIQUID LIN	NE	EVAP				REFRIG	ERANT			
Z	RTIC RIZO	IAM	LEN	VEI				20.,	ם"	LINE I.D.	I.D.		TEMP	R-4	10A	R-1	34a	R-	22	R-4	104a
PAR	VE HO	(۵	#	_	R-410A	R-134a	R-22	R-404a	1			J		MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
													+40°F	2.10	0.19	0.90	0.13	2.00	0.18	1.55	0.15
HX3701	V	4	7-1/8	3.0	1.9	2.2	2.1	1.9	KN	ו	1	r	+20°F	1.31	0.17	0.54	0.11	1.25	0.16	1.00	0.12
										> 5/8	3/8	,	0°F	0.89	0.13	0.36	0.10	0.85	0.13	0.70	0.10
HX3702	V	4	11-1/8	5.5	3.6	4.2	4.0	3.6	KN	1			-20°F	0.58	0.11	0.22	0.08	0.55	0.11	0.45	0.08
										•	`		-40°F	0.36	0.09	0.13	0.06	0.35	0.90	0.25	0.07
										•			+40°F	3.15	0.23	1.62	0.14	3.0	0.22	2.8	0.22
										- 1-			+20°F	2.21	0.19	1.03	0.11	2.1	0.18	2.0	0.18
HX3703	V	4	11-3/8	5.6	3.5	4.1	4.0	3.7	KN	3/4	3/8	Ĺ	0°F	1.57	0.17	0.63	0.10	1.5	0.16	1.4	0.15
										J		Lŀ	-20°F	1.15	0.13	0.43	0.09	1.1	0.13	0.8	0.13
												_	-40°F	0.60	0.10	0.25	0.06	0.6	0.10	0.5	0.10
UV2720		_	12	0.0	7.0	0.0	7.0	C 0	EN	1	1	rŀ	+40°F	4.20	0.55	2.25	0.35	4.0	0.53	4.0	0.54
HX3738	V	5	13	9.0	7.0	8.0	7.9	6.9	EN	7/8	1/2)	+20°F	3.15 2.41	0.47	1.62 0.87	0.30	3.0	0.45	3.0	0.45
										(''°	1/4	1	-20°F	1.57	0.41	0.87	0.25	1.5	0.39	1.3	0.39
										J	· ·	L	-40°F	0.94	0.34	0.36	0.16	0.9	0.33	0.7	0.33
										_		_	+40°F	9.45	0.80	4.35	0.48	8.0	0.76	9.0	0.76
HX3700	V	6	15	15.0	11.5	13.1	12.9	11.4	MN	ו	1	r	+20°F	6.51	0.68	2.88	0.43	6.2	0.65	6.0	0.65
										11/8	5/8	! t	0°F	4.51	0.59	1.83	0.36	4.3	0.56	4.0	0.56
										,	-, -	1	-20°F	2.94	0.49	1.21	0.29	2.8	0.47	2.5	0.47
										•	,		-40°F	1.89	0.39	0.78	0.15	1.8	0.38	1.4	0.38
													+40°F	17.8	2.10	7.20	1.35	17.0	2.00	15.0	2.00
HX3706	V	6	20-1/4	20.5	15.6	17.8	17.5	15.4	MN				+20°F	11.5	2.00	5.40	1.16	11.0	1.90	10.0	1.90
										1 3/8	5/8		0°F	8.08	1.68	3.42	0.97	7.7	1.60	7.0	1.60
HX3836	Н	6	22-1/2	20.0	15.2	17.3	17.1	15.1	MN			L	-20°F	5.25	1.36	2.16	0.87	5.0	1.30	4.5	1.30
											· ·	_	-40°F	3.15	1.15	1.26	0.68	3.0	1.10	2.5	1.10
		-	212/1	2= 0	20.4	22.2		10.0		•	4	•	+40°F	29.4	2.10	11.7	1.35	28.0	2.00	25.0	2.00
HX3704	V	6	24-3/4	27.0	20.1	22.9	22.6	19.9	MN	1-4-	2/4)	+20°F	19.9	2.00	8.1	1.16	19.0	1.9	18.0	1.90
UV2010	- 11	-	20	20.2	10.0	21.0	24.2	10.0	NANI	15/8	3/4)	0°F	13.6	1.68	5.4	0.97	13.0	1.6	12.0	1.60
HX3810	Н	6	30	26.3	19.0	21.6	21.3	18.8	MN	J		Lŀ	-20°F -40°F	8.40 5.25	1.36	3.6 2.8	0.87	8.0 5.0	1.3	7.0 4.0	1.30
\vdash									 			┪	+40°F	61.9	5.09	28.8	3.57	59.0	5.8	55.0	5.8
HX3639	V	8-5/8	20	50.0	Δ	31.3	30.9	27.2	*	1	1	rŀ	+40 F	43.0	5.46	18.9	3.09	41.0	5.2	49.0	5.2
.17.3033	٧	3 3/8	20	30.0	۵	31.3	30.3	27.2		21/2	7/8	!	0°F	28.3	4.51	12.6	2.51	27.0	4.3	26.0	4.3
HX3839	Н	6	48	40.0	36.8	41.3	41.3	36.4	MN],,	1 t	-20°F	18.5	3.88	7.2	2.03	18.0	3.7	16.0	3.7
						5	5		<u> </u>	J	\	•	-40°F	12.6	2.83	4.5	1.64	12.0	2.7	10.0	2.7
											,		+40°F	Δ	Δ	45.0	5.70	90.0	9.5	85.0	9.5
													+20°F	Δ	Δ	29.7	5.02	62.0	8.4	60.0	8.4
HX3641	V	10-3/4	20	65.0	Δ	51.4	50.7	44.7	*	2 5/8	13/8	. [0°F	Δ	Δ	19.8	4.06	42.0	7.0	40.0	7.0
HX3841	Н	8-5/8	24	63.0	Δ	45.2	44.6	39.3	*				-20°F	Δ	Δ	11.7	3.28	28.0	6.0	25.0	6.0
										•	<u>'</u>	•	-40°F	Δ	Δ	7.2	2.70	18.0	4.2	15.0	4.2
													+40°F	Δ	Δ	63.0	9.66	130	15.0	125	15.0
HX3640	V	10-3/4	26	75.0	Δ	72.7	72.5	63.9	*]	+20°F	Δ	Δ	48.6	8.40	90.0	13.0	90.0	13.0
HX3840	Н	10-3/4	24	68.0	Δ	71.3	70.4	62.0	*	3 1/8	13/8		0°F	Δ	Δ	33.3	6.57	60.0	11.0	60.0	11.0
HX3873	H	10-3/4	48	114	Δ	151.5	149.5	131.7	*	J		L	-20°F	Δ	Δ	20.7	5.89	40.0	9.3	40.0	9.3
HX3874	Н	10-3/4	60	120	Δ	191.6	189.1	166.5	*	•	· ·		-40°F	Δ	Δ	11.7	4.64	28.0	7.5	25.0	4.5

Suction Accumulators of 6" diameter or smaller are (L) and c(L) LISTED File No. SA2400 (Hydrogen copper brazed construction)
Suction Accumulators larger than 6" diameter are made to ASME Code. (Shielded arc welded construction) ASME # Length in inches includes nipples



 $^{\ \ \, \}text{t} \,\, \text{Maximum and minimum recommended tons based on pressure drop and oil return through Suction Accumulators}.$

[†] Minimum recommended tons based on oil return through Suction Accumulators.

 $[\]Delta$ These ASME models are not intended for use with R-410A refrigerant. See alternate line for R-410A ASME Models.

[•] Electric float not available on HX models.

[•]Suction Accumulators rated for 450 PSI (UL); 350 (ASME)

HEAT PUMP SUCTION ACCUMULATORS

Having pioneered the suction accumulator as a protective component, and having made them continuously over a period of 50 years, Refrigeration Research has acquired considerable experience. However, it has always been our recommendation that tests be made by the system manufacturer to check pressure drop, size of orifice and holding capacity of the accumulator for a particular application.

As a result of tests made by our customers as well as by Refrigeration Research, modifications have been made in many cases for heat pump applications. Our inlet deflector tube baffle, smaller metering orifices and protective screens have proven to be a value. In addition, accumulators for heat pumps may usually be designed for less pressure drop.

Many hundreds of thousands of suction accumulators having inlet deflectors, smaller orifices, and protective strainers have been built by Refrigeration Research and are on systems operating successfully in the field.


Seven models of these field proven heat pump type accumulators are offered as catalog items instead of specials.

All accumulators are complete with a fusible plug to comply with (\$\frac{1}{2}\bigcup\$) and \$\cdots\$(\$\frac{1}{2}\bigcup\$) requirements. CE documentation also available upon request.

In the heat pump system, the suction accumulator must be installed between the compressor and the reversing valve.

Copper nipples are standard on all (VL) and (VL) models.

Steel nipples are available on special order.

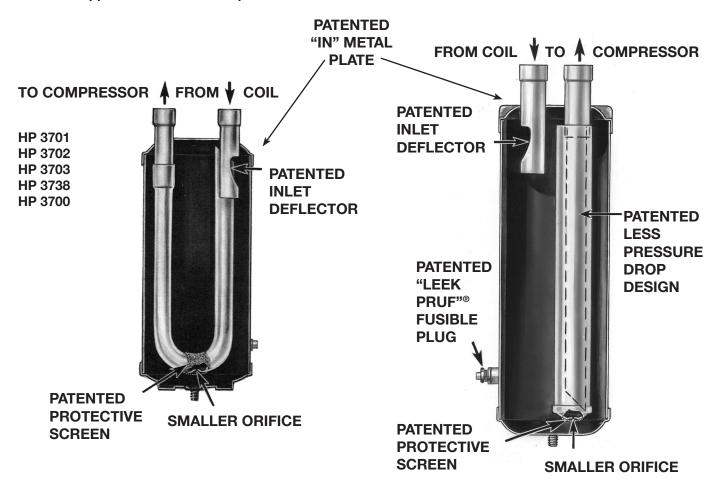

MADE UNDER ONE OR MORE OF THE FOLLOWING PATENTS: NOS.: 5,076,313; 5,075,967; AND PATENTS APPLIED FOR.

PHOTOS FOR ILLUSTRATIVE PURPOSE ONLY - DO NOT USE AS A GUIDE FOR INSTALLATION.



APPLICATION DATA FOR **HEAT PUMP SUCTION ACCUMULATORS**

ĒR	۲ <u>۲</u>												† REC	OMMEN	IDED TO	NS OF RE	FRIGERA	ATION	
PART NUMBER	VERTICAL OR HORIZONTAL	DIAMETER (INCHES)	LENGTH	WEIGHT		MUM RI			⊕	SUCTION LINE I.D.	EVAP				REFRIC	ERANT			
RT N	RTIC	IAM (INC	# LEN	WEI			,	,	טו	SOCTION LINE I.D.	TEMP	R-4	10A	R-1	34a	R-	22	R-4	04a
PAI	YE VE]	#		R-410A	R-134a	R-22	R-404a				MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
) (+60°F	2.60	0.23	1.15	0.15	2.56	0.20	2.20	0.19
HP3701	V	4	7-1/8	3.0	1.9	2.2	2.1	1.9	KN		+50°F	2.35	0.21	1.11	0.14	2.30	0.19	1.90	0.17
										> 5/8 <	+40°F	2.10	0.19	0.90	0.13	2.00	0.18	1.55	0.15
HP3702	V	4	11-1/8	4.6	3.6	4.2	4.0	3.6	KN		+20°F	1.31	0.17	0.54	0.11	1.25	0.16	1.00	0.12
										•	0°F	0.89	0.13	0.36	0.10	0.85	0.13	0.70	0.10
										1	+60°F	3.80	0.27	2.20	0.16	3.7	0.25	3.6	0.25
										l	+50°F	3.50	0.25	2.00	0.15	3.4	0.24	3.2	0.24
HP3703	V	4	11-3/8	5.2	3.5	4.1	4.0	3.7	KN	> 3/4	+40°F	3.15	0.23	1.62	0.14	3.0	0.22	2.8	0.22
											+20°F	2.21	0.19	1.03	0.11	2.1	0.18	2.0	0.18
										•	0°F	1.57	0.17	0.63	0.10	1.5	0.16	1.4	0.15
										1	+60°F	5.20	0.65	2.70	0.39	5.0	0.60	4.9	0.60
HP3738	V	5	13-1/8	7.7	7.0	8.0	7.9	6.9	EN		+50°F	4.70	0.60	2.50	0.37	4.5	0.57	4.4	0.57
										> 7/8 <	+40°F	4.20	0.55	2.25	0.35	4.0	0.53	4.0	0.53
											+20°F	3.15	0.47	1.62	0.30	3.0	0.45	3.0	0.45
											0°F	2.41	0.41	0.87	0.25	2.3	0.39	2.0	0.39
										•	+60°F	12.0	0.88	5.50	0.56	11.9	0.84	11.5	0.84
HP3700	V	6	15	13.0	11.5	13.1	12.9	11.4	MN	/ .	+50°F	10.8	0.84	5.00	0.53	10.75	0.80	10.5	0.80
										1 -1/8	+40°F	9.45	0.80	4.35	0.48	9.0	0.76	9.0	0.76
											+20°F	6.51	0.68	2.88	0.43	6.2	0.65	6.0	0.65
										•	0°F	4.51	0.59	1.83	0.36	4.3	0.56	4.0	0.56
										•	+60°F	21.5	2.30	9.00	1.60	21.1	2.20	19.0	2.20
HP3706	V	6	20-1/4	17.0	15.6	17.8	17.5	15.4	MN	1 2 2 2	+50°F	19.5	2.20	8.00	1.50	19.0	2.10	17.0	2.10
										1 -3/8	+40°F	17.8	2.10	7.20	1.35	17.0	2.00	15.0	2.00
											+20°F	11.5	2.00	5.40	1.16	11.0	1.90	10.0	1.90
										•	0°F	8.08	1.68	3.42	0.97	7.7	1.60	7.0	1.60
										1	+60°F	36.0	2.50	14.5	1.50	35.6	2.10	32.0	2.10
HP3704	V	6	24-3/4	20.5	20.1	22.9	22.6	19.9	MN		+50°F	33.0	2.30	13.0	1.40	32.0	2.0	29.0	2.00
										1 -5/8	+40°F	29.4	2.10	11.7	1.35	28.0	2.00	25.0	2.00
											+20°F	19.9	2.00	8.1	1.16	19.0	1.9	18.0	1.90
											0°F	13.6	1.68	5.4	0.97	13.0	1.6	12.0	1.60

Suction Accumulators of 6" diameter or smaller are (VL) and c(VL) LISTED File No. SA2400 (Hydrogen copper brazed construction)

Length includes nipples.



File No. SA 2400

"Leek Pruf"® Fusible Plugs

- The "Leek Pruf" plug has a male flare to connect to a female flare on the receiver or accumulator. A soft copper gasket which comes attached and oiled is used and pipe compound is eliminated. The result is a permanent leak tight connection.
- Alloy in the "Leek Pruf" plug is located so that it is not disturbed or under stress when the plug is tightened since the section of the plug containing alloy is not contained within the threaded section. Since "Leek Pruf" plugs by Refrigeration Research use an eutectic alloy (melts sharply at one temperature) and the alloy is not distorted, the relief temperature is positive.

LEEK PRUF® PLUGS ARE EXCLUSIVE ON RECEIVERS AND ACCUMULATORS BY REFRIGERATION RESEARCH.

APPROVED AND USED BY LEADING CONDENSING UNIT AND SYSTEM MANUFACTURERS.



984

		AMMINIST	
3/8	SAE FI	LARE	


FITTING TO RECEIVER 1/4 SAE FLARE	FITTING TO RECEIVER 3/8 SAE FLARE
PART NO.	FITTING TO OUTSIDE TUBE 1/2 SAE FLARE PART NO.
982-430°	984-430°

U.S. Patent Nos. 3,139,103; 5,076,313

Fusible Alloy: 430°F



File No. SA 3584



alloy not under stress





[†] Maximum and minimum recommended tons based on pressure drop and oil return through Suction Accumulator.

Suction Accumulators rated for 450 PSI.

A.S.M.E. SUCTION ACCUMULATORS (R410A)

 Refrigeration Research, Inc. is pleased to announce new, A.S.M.E. certified suction accumulators intended for use with R410A refrigerant.




 A.S.M.E. suction accumulators available in standard sizes and volumes, to make your transition to R410A as seamless as possible.

 All A.S.M.E. suction accumulators are finished with corrosionresistant powder paint suitable for most harsh environments.

 Refrigeration Research, Inc. also has the ability to provide Canadian Registration Numbers with these quality components.







APPLICATION DATA FOR A.S.M.E. SUCTION ACCUMULATORS 450 P.S.I. A.S.M.E. DESIGN PRESSURE

æ	٦ ٧														† REC	OMMEN	DED TON	IS OF REF	RIGERAT	ION	
PART NUMBER	VERTICAL OR HORIZONTAL	ETER 1ES)	БТН	H	MAXIM	UM REFRIG		OLDING	HX INLET	SU	CTION I	NLET	EVAP				REFRIG	ERANT			
AT NI	RTIC	DIAMETER (INCHES)	# LENGTH	WEIGHT		0,11,71011	. (255.)		I.D.	OU.	TLET I.D	. SIZE	TEMP	R-41	.0A	R-1	34a	R-	-22	R-4	104a
PA	H VE		-		R-410A	R-134a	R-22	R-404a						MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
													+40°F	29.40	2.10	11.70	1.35	28.00	2.00	25.00	2.00
3648	V	8-5/8	20	44	27.5	31.3	30.9	27.2					+20°F	19.90	2.00	8.10	1.16	19.00	1.90	18.00	1.90
HX3648	٧	8-5/8	20	50	27.5	31.3	30.9	27.2	3/4"	 	1-5/8	I₹	0°F	13.60	1.68	5.40	0.97	13.00	1.60	12.00	1.60
													-20°F	8.40	1.36	3.60	0.87	8.00	1.30	7.00	1.30
													-40°F	5.25	1.15	1.80	0.68	5.00	1.10	4.00	1.10
													+40°F	61.90	5.46	28.80	3.57	59.00	5.80	55.00	5.80
3642	V	8-5/8	20	44	27.5	31.3	30.9	27.2					+20°F	43.00	5.09	18.90	3.09	41.00	5.20	39.00	5.20
3649	V	10-3/4	20	60.5	45	51	50	44		│	2-1/8		0°F	28.30	4.51	12.60	2.51	27.00	4.30	26.00	4.30
HX3642	V	8-5/8	20	50	27.5	31.3	30.9	27.2	7/8"			Ц	-20°F	18.50	3.88	7.20	2.03	18.00	3.70	16.00	3.70
HX3649	V	10-3/4	20	66.5	45	51	50	44	7/8"	_		•	-40°F	12.60	2.83	4.50	1.64	12.00	2.70	10.00	2.70
HX3847	Н	8-5/8	24	63	39.8	45.2	44.6	39.5	1-3/8"				+40°F	94.50	9.97	45.00	5.70	90.00	9.50	85.00	5.80
3643	V	10-3/4	20	57	45.2	51.4	50.7	44.7					+20°F	65.10	8.82	29.70	5.02	62.00	8.40	60.00	5.20
3847	Н	8-5/8	24	48	39.8	45.2	44.6	39.3		│	2-5/8		0°F	44.10	7.35	19.80	4.06	42.00	7.00	40.00	
8830	Н	8-5/8	48	106	66	75.1	74.2	65.3		IJ		H	-20°F	29.40	6.30	11.70	3.28	28.00	6.00	25.00	
HX3643	V	10-3/4	20	66.5	45	51	50	44	1-3/8"			_	-40°F	18.50	4.41	7.20	2.70	18.00	4.20	15.00	_
HX3644		10-3/4	26	85	64	72	72	63	1-3/8"	1		1	+40°F	136.50	15.70	63.0	9.66	130.0	15.0		15.00
3644		10-3/4	26	75	64.6	72.7	72.5	63.9		ł			+20°F	94.50	13.60	48.60	8.40	90.00	13.0	90.0	13.00
3846		10-3/4	24	63	62.8	71.3	70.4	62		}	3-1/8	1	0°F	63.00	11.50	33.30			11.00		11.00
3645	V	12-3/4	26	100	85.4	93.5	93	84	4.0/01	IJ		l	-20°F	42.00	9.76	20.70	5.89	40.00	9.30	40.00	
HX3846	Н	10-3/4	24	72	62	71	70	61	1-3/8"			•	-40°F	29.40	7.87	11.70	4.64	28.00	7.50	25.00	4.50

[†] Maximum and minimum recommended tons based on pressure drop and oil return through Suction Accumulator.

[#] Length includes nipples.



HX designates Heat Exchanger - Suction Accumulator with heat exchanger coil added for increased liquid line subcooling.

No Sweat-No Frost Suction Accumulator by **REFRIGERATION RESEARCH**, INC.

The "No Sweat" – "No Frost" Heat Exchanger Suction Accumulator <u>PREVENTS</u> frost and condensation and PROTECTS from corrosion and water damage. With innovative



system design it can also serve as a receiver as well as a heat exchanger, thereby saving additional space.

These heat exchanger – suction accumulators benefit a system in four ways: 1) Protects the compressor from refrigerant floodback 2) Subcools the liquid refrigerant for greater system efficiency 3) Stops condensation and frost from forming through unique design 4) Saves space by combining the suction accumulator, and heat exchanger all in one component to provide a more compact design.

Accumulator does not sweat or frost. Therefore <u>cost</u> of insulating accumulator is <u>eliminated</u>. Greater heat exchange surface <u>improves efficiency</u>.

PART NO.	HORIZONTAL OR VERTICAL	DIAMETER	LENGTH	WEIGHT	MAXIM	UM REFRIG		OLDING	UL CODE	SUCTION	LIQUID	EVAP			† RECOMM	MENDED TO	NS OF REFR	IGERATION		
2	RIZ	ΑV	Ē	VEI			,		IDENT	LINE I.D.	LINE I.D.	TEMP	R-4	10A	R-1	34a	R-	22	R-4	04a
2	표 유	a	#	1	R-410A	R-134a	R-22	R-404a	IDLINI				MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
HXM3701	٧	5	9-3/8	11	1.9	2.2	2.1	1.9	KN	1	(+40°F	2.10	0.19	0.90	0.13	2.00	0.18	1.55	0.15
											J	+20°F	1.31	0.17	0.54	0.11	1.25	0.16	1.00	0.12
HXM3702	V	5	11-1/8	12	3.6	4.1	4	3.7	KN	5/8	3/8	0°F	0.89	0.13	0.36	0.10	0.85	0.13	0.70	0.10
										J	l	-20°F	0.58	0.11	0.22	0.08	0.55	0.11	0.45	0.08
												-40°F	0.36	0.09	0.13	0.06	0.35	0.90	0.25	0.07
										١	(+40°F	3.15	0.23	1.62	0.14	3.00	0.22	2.80	0.22
										L	J	+20°F	2.21	0.19	1.03	0.11	2.10	0.18	2.00	0.18
HXM3703	V	5	11-3/8	12	3.5	4.1	4	3.7	KN	3/4	3/8	0°F	1.57	0.17	0.63	0.10	1.50	0.16	1.40	0.15
										J	L	-20°F	1.15	0.13	0.43	0.09	1.10	0.13	0.80	0.13
												-40°F	0.60	0.10	0.25	0.06	0.60	0.10	0.50	0.10
										١	(+40°F	4.20	0.55	2.25	0.35	4.00	0.53	4.00	0.54
HXM3738	V	5	13-1/8	10	7	6.3	6.2	5.5	EN	l	J	+20°F	3.15	0.47	1.62	0.30	3.00	0.45	3.00	0.45
										7/8	3/8	0°F	2.41	0.41	0.87	0.25	2.00	0.39	2.00	0.39
										J	L	-20°F	1.57	0.34	0.63	0.20	1.50	0.33	1.30	0.33
												-40°F	0.94	0.28	0.36	0.16	0.90	0.27	0.70	0.27
										1	(+40°F	9.45	0.80	4.35	0.48	9.00	0.76	9.00	0.76
HXM3700	V	6	15	17	11.5	10.3	10.1	9	MN	l	J	+20°F	6.51	0.68	2.88	0.43	6.20	0.65	6.00	0.65
										1-1/8	1/2	0°F	4.51	0.59	1.83	0.36	4.30	0.56	4.00	0.56
										J	L	-20°F	2.94	0.49	1.21	0.29	2.80	0.47	2.50	0.47
												-40°F	1.89	0.39	0.78	0.15	1.80	0.38	1.40	0.38
										1		+40°F	17.80	2.10	7.20	1.35	17.00	2.00	15.00	2.00
HXM3706	٧	6	20-1/4	23	15.6	13.9	13.7	12	MN	L	I J	+20°F	11.50	2.00	5.40	1.16	11.00	1.90	10.00	1.90
										1-3/8	5/8	0°F	8.08	1.68	3.42	0.97	7.70	1.60	7.00	1.60
										J	L	-20°F	5.25	1.36	2.16	0.87	5.00	1.30	4.50	1.30
												-40°F	3.15	1.15	1.26	0.68	3.00	1.10	2.50	1.10
										1		+40°F	29.40	2.10	11.70	1.35	28.00	2.00	25.00	2.00
HXM3704	V	6	25	30	20.1	17	16.8	14.7	MN	l L	I J	+20°F	19.90	2.00	8.10	1.16	19.00	1.90	18.00	1.90
										1-5/8	5/8	0°F	13.60	1.68	5.40	0.97	13.00	1.60	12.00	1.60
										J	l	-20°F	8.40	1.36	3.60	0.87	8.00	1.30	7.00	1.30
												-40°F	5.25	1.15	1.80	0.68	5.00	1.10	4.00	1.10

Made under one or more of the following patents: nos.: 5,479,790; 5,722,146; 6,253,572; And patents applied for.

• Suction Accumulators rated for 450 PSI.



DISCHARGE MUFFLERS

Some systems are noisy due to vibration and pulsation of gas through the discharge line. To smooth out pulsations and reduce vibration and noise, Refrigeration Research offers the industry's most complete line of Discharge Mufflers.

Refrigeration Research has long been a leading manufacturer of mufflers in production quantities and was first to offer a complete catalog line.

All mufflers are of hydrogen copper brazed steel construction insuring maximum strength and complete cleanliness.



M-20 DISCHARGE MUFFLER SHOWN

CATALOG NUMBER	PART NUMBER	TONS	O.D	OVERALL LENGTH	FITTING SIZE	WEIGHT (LBS.)	REMOVABLE FUSIBLE PLUG	UL CODE
M-2	1760	2	2	7-7/16	3/8	1.0	Not Required	MUF2
M-3	1761	3	2	7-7/16	1/2	1.0	Not Required	MUF2
M-5	1762	5	2	7-7/16	5/8	1.0	Not Required	MUF2
M-10	1758	7-1/2 to 10	3	9	7/8	2.6	Not Required	MUF3
M-15	1792	10 to 15	3	9-1/4	1-1/8	2.8	Not Required	MUF3
M-20	1771	15 to 25	3	13-3/4	1-3/8	3.3	Not Required	MUF3
M-30	1772	25 to 50	4	16	1-5/8	6.5	Installed	MUF4
M-60	1790	50 to 75	6	26-1/2	2-1/8	26.0	Installed	MUF6
M-80	1791	75 to 100	6	28	2-5/8	27.0	Installed	MUF6
M-110	1793	100 to 125	6	36	3-1/8	32.5	Installed	MUF6

UL LISTED

File No. SA 3089

Mufflers are rated for 450 PSI.

HIGHER PRESSURE DISCHARGE MUFFLERS

These "Green Label" discharge mufflers are uniquely designed for the higher pressure requirements for systems using R-410A. The tough requirements needed for these special models are made to the approved Underwriters Laboratory requirements necessary to meet the 675 p.s.i.g. working pressure.*Models MH-30, MH-60, MH-80 and MH-110 require pressure relief valve (not supplied). The chart below shows the models available.

CATALOG NUMBER	PART NUMBER	TONS	FITTING SIZE (INCHES)	O.D. (INCHES)	OVERALL LENGTH	UL CODE
MH-2	1718	2	3/8	2	7-7/16	MRN
MH-3	1719	3	1/2	2	7-7/16	MRN
MH-5	1720	5	5/8	2	7-7/16	MRN
MH-10	1721	7-1/2 to 10	7/8	3	9	MSN
MH-15	1722	10 to 15	1-1/8	3	9-1/4	MSN
MH-20	1723	15 to 25	1-3/8	3	13-3/4	MSN
MH-30*	1725	25 to 50	1-5/8	4	16	MTN
MH-60*	1728	50 to 75	2-1/8	6	26-1/2	MVN
MH-80*	1745	75 to 100	2-5/8	6	28	MVN
MH-110*	1746	100 to 125	3-1/8	6	36	MVN

*4" O.D. and above require pressure relief valve, not supplied.

Rated for 675 PSI.

File No. SA 3089



THE POPULAR AND EXCLUSIVE

ADJUSTABLE MUFFLER

This original discharge muffler development by Refrigeration Research permits "tuning" the muffler to the system.

For the first time it is possible to change muffler characteristics without installing a different muffler or even breaking into the system. In fact the muffler may be adjusted without losing charge and while the system is in operation.

The adjustable muffler is provided with a stem which may be turned to "tune" the muffler to the system. It is a well known fact that two systems made up of the same components do not always sound the same when installed in different locations. One may be noisy while the other is relatively quiet. Individual compressor characteristics, length and diameters of lines and other factors may make the difference.

The Bull Dog Adjustable Muffler by Refrigeration Research provides a variable range of muffler characteristics so that the best performance with a particular system can be attained.



CATALOG NUMBER	PART NUMBER	TONS	O.D	OVERALL LENGTH	FITTING SIZE	WEIGHT (LBS.)	UL CODE
AM-5	1825	2 to 5	4	10	5/8	5.5	AM4
AM-10	1824	5 to 10	4	11	7/8	6	AM4
AM-25	1823	10 to 25	4	14-1/4	1-1/8	7.5	AM4

(UL) LISTED

File No. SA 3089

All mufflers are in accordance with latest und supplements, diameters above 3" being furnished complete with Refrigeration Research "Leek Pruf" fusible plugs installed. All mufflers may be mounted horizontally or vertically as long as instructions are followed. CE documentation available upon request.

High Pressure Adjustable Muffler

The high pressure Bull Dog Adjustable Muffler is UL rated for 675 PSI with R-410a. Comes standard with high pressure relief valve (not installed)



CATALOG NUMBER	PART NUMBER	TONS	O.D	OVERALL LENGTH	FITTING SIZE	WEIGHT (LBS.)	UL CODE
AMH-5	1820	2 to 5	4	10	5/8	5.5	AM4
AMH-10	1821	5 to 10	4	11	7/8	6	AM4
AMH-25	1822	10 to 25	4	14-1/4	1-1/8	7.5	AM4


Supplied with pressure relief valve



[•]Rated for 675 PSI.

RECEIVERS WITHOUT VALVES

(U.L. RECOGNIZED)



These reliable UL recognized receivers provide excellent durability and flexibility to fit a variety of applications as either replacement parts or for original equipment. The hydrogen brazed construction provides superior internal cleanliness. They are 100% pressure tested to ensure integrity and powder coated for excellent corrosion resistance. The recessed cap and 3/8" or 1/2" mounting stud provide a sturdy base for mounting in the vertical position (all parts must mount vertically).

These receivers, unlike other receivers, <u>do not have fusible plugs</u> and must be used only where a pressure relief or fusible is installed elsewhere in the system. These parts can be made with 430°F Fusible installed and UL listed upon special order and in quantity.

PART NUMBER	PUMP DOWN CAPACITY	"A" DIAMETER	"B" LENGTH	INLET CONNECTION	"C" INLET DIMENSION	OUTLET CONNECTION	UL CODE
5721	1.5 LBS.	3"	7"	1/4" SWEAT	2.37"	1/4" SWEAT	HN
5722	3 LBS.	4"	8"	3/8" SWEAT	2.56"	3/8" SWEAT	KN
5723	7 LBS.	5"	12"	3/8" SWEAT	2.69"	3/8" SWEAT	EN
5724	10 LBS.	6"	12"	3/8" SWEAT	2.81"	3/8" SWEAT	MN
5727	13 LBS.	6"	15"	1/2" SWEAT	2.81"	1/2" SWEAT	MN
5728	17 LBS.	6"	19"	1/2" SWEAT	2.81"	1/2" SWEAT	MN

^{*90%} AT 90° for R22, R134a and R502 - For R12 multiply by 1.1 - For R402b and R404a multiply by 0.9



File No. SA 2400 Vol. 2

Models available for use with R410A, contact our engineering department

BULL'S EYE SIGHT GLASSES

Regular and "moisture-indicating" Bull's Eye Sight Glasses provide a full view of the refrigerant level at all times. The sight glasses are plated steel with 5/16" diameter polyethylene "floating" ball. They must be sealed with "Loctite" Refrigerant Sealer No. 55441 (or similar sealer) around the 1/2 - 14 NPTF thread. THIS SIGHT GLASS IS SUITABLE FOR R410A.





Regular - Part No. 1523

Moisture Indicating Part No. 1536

PRISM SIGHT GLASSES

The prism sight glass eliminates the need for the polyethylene floating ball. For use with fittings 1/2 - 14 NPTF thread and Refrigerant Sealer.



Prism Sight Glass RR Part No. 7690

WELDED SIGHT GLASSES

Contact engineering department for application details.





Welded Sight Glass RR Part No. 1521



[•] Receivers rated for 500 PSI.

RECEIVERS

Refrigeration Research Receivers have been made continuously for over 50 years. Standard catalog models are shown below, however, hundreds of special models are made as well. They are used widely by original equipment manufacturers throughout the industry. They are backed by a reputation for quality and service. Contact engineering department for special designs.

Available in a broad range of types and sizes, these receivers with valves and fittings attached are hydrogen brazed for cleanliness and pressure tested for reliability. A 430°F Fusible plug is installed on all receivers except #2030, #2038, #2039, and #9028. All valves are supplied with steel stem caps with copper gaskets and brass flare nuts and caps. All receivers are powder coated for excellent corrosion resistance. Pressure tested for 500 p.s.i. maximum working pressure.

Type 1	PART	*PUMP DOWN	DIAMETER & LENGTH OVER	INLET	OUTLET	WT. LBS.	(ŪL) CODE
-	NUMBER	CAPACITY	END CAPS	INLEI	OUILEI	LBS.	Ident.
	2030	2 lb.	3 x 10	1/4 ID Sweat	1/4 ID Sweat	2.4	HN
	2038	1.5 lb.	2 x 8	1/4 ID Sweat	1/4 O.D. Copper Nipple	1.0	AL
	2039	1.5 lb.	3 x 7	1/4 ID Sweat	1/4 ID Sweat	2	HN
Vertical Mount							
Type 2	1947	3 lb.	3 1/2 x 9	3/8 ID	3/8 SAE Valve	3.3	PN
Horizontal Mount				- Oweat	vaivo		
Type 3	5774	2 lb.	3 x 10	1/4 SAE Fitting	1/4 SAE Valve	3	HN
	9028	2 lb.	3 x10	1/4 ID Sweat	1/4 ID Sweat Valve	3	HN
	1920	2 lb.	3 1/2 x 7 1/2	1/4 SAE Fitting	1/4 SAE Valve	2.9	PN
in the second	1917	3 lb.	3 1/2 x 10	1/4 SAE Fitting	1/4 SAE Valve	3.5	PN
	9017	3 lb.	3 1/2 x 10	1/4 ID Sweat	1/4 ID Sweat Valve	3.5	PN
	1921	4 lb.	4 x 10	1/4 SAE Fitting	1/4 SAE Valve	4.5	KN
	9021	4 lb.	4 x 10	1/4 ID Sweat	1/4 ID Sweat Valve	4.5	KN
	1918	6 lb.	5 x 10	1/4 SAE Fitting	1/4 SAE Valve	7.2	EN
	5315	6 lb.	5 x 10	3/8 SAE Fitting	3/8 SAE Valve	7.3	EN
	6848	6 lb.	5 x 10	3/8 ID Sweat	3/8 ID Sweat Valve	7.3	EN
	1911	10 lb.	6 x 12	3/8 SAE Fitting	3/8 SAE Valve	10.9	MN
	6801	10 lb.	6 x 12	3/8 ID Sweat	3/8 ID Sweat Valve	10.9	MN
	3212	16 lb.	6 x 18	1/2 SAE Fitting	1/2 SAE Valve	15.6	MN
Vertical Mount	9027	16 lb.	6 x18	1/2 ID Sweat	1/2 ID Sweat Valve	15.6	MN
	3213	22 lb.	6 x 24	1/2 SAE Fitting	1/2 SAE Valve	18	MN
Type 4	1916	8 lb.	4 x 19	1/4 Sweat	1/4 SAE	7.5	KN
¥ .	1915	12 lb.	5 x 18	1/4 Sweat	Valve 3/8 SAE Valve	11.4	EN
Horizontal Mount	1919	19 lb.	5 x 28	3/8 Sweat	3/8 SAE Valve	16.6	EN
∯ Type 5							
41	1922	15 lb.	5 X 23	3/8 Sweat	3/8 SAE	14.5	EN
	1000	45 11.	5 00	1/0.0	Valve	4.5	
Horizontal Mount	1923	15 lb.	5 x 23	1/2 Sweat	1/2 SAE Valve	15	EN

*90% AT 90° for R22, R134a and R502 - For R12 multiply by 1.1 - For R402b and R404a multiply by 0.9 500 psi Working Pressure


وَالْهِ LISTED

File No. SA 2400 Vol. 1





RECEIVERS FOR ROTALOCK FITTINGS



Receivers below are of hydrogen copper brazed construction insuring maximum cleanliness and strength.

These premium receivers are designed for either horizontal or vertical mounting and for use with Rotalock valves and fittings to make them as universal in application as possible. All of these receivers have "Leek Pruf" fusible plugs installed and are powder coated.

Rotalock receivers do not include valves or fittings, but are supplied with Teflon Gasket installed. These receivers are pressure tested for 500 p.s.i. working pressure.

PART NUMBER	*PUMP DOWN CAPACITY	DIAMETER & LENGTH OVER END CAPS	INLET FITTING	OUTLET FITTING	MOUNT	LEEK PRUF FUSIBLE PLUG	WEIGHT POUNDS	ÇUL CODE IDENT.
3392	4 lb.	4 x 10	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	4.7	KN
3388	6 lb.	5 x 10	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	7.3	EN
3390	13 lb.	5 x 20	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	12.3	EN
3389	10 lb.	6 x 12	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	11.1	MN
3413	16 lb.	6 x 18	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	14.5	MN
3391	22 lb.	6 x 24	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	18.3	MN
3387	28 lb.	6 x 30	1" Rotalock	1" Rotalock	Horiz. or Vert.	R	22.0	MN

*90% AT 90° for R22, R134a and R502 - For R12 multiply by 1.1 - For R402b and R404a multiply by 0.9 P-Permanent R-Removable 500 psi Working Pressure



(CE) marking available upon request.

File No. SA 2400 Vol. 1

AVAILABLE 1" ROTALOCK VALVES AND FITTINGS FOR RECEIVERS

Horizontal Valves

27/18 – 3/8 SAE flare 27689 – 1/2 SAE flare

27691 - 5/8 SAE flare

Horizontal Valves

23075 – 3/8 I.D. Sweat 24601 – 1/2 I.D. Sweat

24602 - 5/8 I.D. Sweat

Vertical Valves

27742 – 3/8 SAE flare 27035 – 1/2 SAE flare 27036 – 5/8 SAE flare

Vertical Valves

24606 – 3/8 I.D. Sweat 24490 – 1/2 I.D. Sweat 24491 – 5/8 I.D. Sweat Straight Adapters

24246 – 3/8 I.D. Sweat 24247 – 1/2 I.D. Sweat 24248 – 5/8 I.D. Sweat

Teflon Gasket No. 24591

Angle Adapters

24957 – 3/8 SAE flare 24958 – 1/2 SAE flare 24959 – 5/8 SAE flare

Angle Adapters

24252 – 3/8 I.D. Sweat 24253 – 1/2 I.D. Sweat 24254 – 5/8 I.D. Sweat




ASME RECEIVERS FOR ROTALOCK FITTINGS

These larger receivers are assembled by shielded arc weld construction. They are made to ASME code and marked with an attached metal tag. Rotalock connections 1 1/4"-12 are used on these receivers for valves or fittings (not included) shown below. +Part numbers 3105 and 3106 are supplied with 1"-14 Rotalock connectors. A 1/2" pipe fitting is supplied for a pressure relief or a pop-off valve (not supplied). All parts are painted with epoxy powder coating. Working pressure is 450 p.s.i. maximum.


Welded mounting brackets are attached on the vertical models. Adjustable mounting brackets are also available for the horizontal models, but not included or attached to the part. RR7187 (8 5/8" Dia.); RR7188 (10 3/4" Dia.).

Special ASME receivers in quantity can be made upon request. These include different lengths, welded mounting brackets, higher working pressure, special fittings and fitting locations to suit your applications. Contact our Engineering Department about your needs.

	*Pump		"B"		
**Part	Down	"A"	Length	Horz. Or	Shipping
Number	Capacity	Diameter	Over Caps	Vert.	Wt.
3105+	19	8 5/8	12	Vert.	24
3106+	27	8 5/8	16	Vert.	29
3290	31	8 5/8	18	Vert.	38
3107	43	8 5/8	24	Vert.	41
3291	47	10 3/4	18	Vert.	50
3292	65	10 3/4	24	Vert.	65
3295	70	12 3/4	18	Vert.	70
3296	78	12 3/4	20	Vert.	78
3297	92	12 3/4	24	Vert.	92



	*Pump		"B"		
**Part	Down	"A"	Length	Horz. Or	Shipping
Number	Capacity	Diameter	Over Caps	Vert.	Wt.
3108	51	8 5/8	28	Horz.	46
3285	66	8 5/8	36	Horz.	66
3109	78	8 5/8	42	Horz.	66
3286	90	8 5/8	48	Horz.	90
3287	104	10 3/4	36	Horz.	104
3288	141	10 3/4	48	Horz.	141



^{*90%} AT 90° for R22, R134a and R502 - For R12 multiply by 1.1 - For R402b and R404a multiply by 0.9

Canadian registration numbers issued for all provinces and territories in Canada upon request.

AVAILABLE 1 1/4" ROTALOCK VALVES AND FITTINGS FOR ABOVE RECEIVERS

Horizontal Valves 24603 – 7/8" I.D. Sweat 24325 – 1 1/8" I.D. Sweat Vertical Valves 24493 – 7/8" I.D. Sweat

24494 - 1 1/8" I.D. Sweat

Right Angle Adapters 24256 – 7/8" I.D. Sweat 24257 – 1 1/8" I.D. Sweat

Straight Adapters 24250 – 7/8" I.D. Sweat 24251 – 1 1/8" I.D. Sweat

Teflon Gasket No. 24592




^{**}Models available for use with R410A, see page 16 and 17 or contact our engineering department.


HIGHER PRESSURE DU PRECEIVERS


These special Models are designed specifically for higher pressure requirements for use in R-410A systems. The tough requirements needed for these "Green Label" Models are made to the approved Underwriters Laboratory requirements necessary to meet the 675 p.s.i.g. working pressure.

Particular steel material requirements, along with special welded fabrication are used with our unique die designs to produce these superior high strength receivers. These come complete with a "Leek Pruf" fusible plug installed as well as our powder coated finish. These are made with Rotalock connections for use with our valve and adapters (not included) also used on our other Rotalock receivers shown in the catalog. Rotolock models can be used for either vertical or horizontal mounting.

PART NUMBER	PUMP DOWN CAPACITY	"A" DIAMETER	"B" LENGTH	FIGURE	INLET & OUTLET CONNECTION	LEEK PRUF FUSIBLE PLUG	UL CODE
2041	1.3 LBS.	3"	7"	I	1/4" Sweat	Not Required	SN
2040	1.8 LBS.	3"	10"	I	1/4" Sweat	Not Required	SN
3307	1.8 LBS.	3"	10"	=	1" Rotalock	Not Required	SN
3308	3.6 LBS.	4"	10"	Ш	1" Rotalock	Installed	TN
3309	5.5 LBS.	5"	10"	Ш	1" Rotalock	Installed	UN
3310	9.0 LBS	6"	12"	Ш	1" Rotalock	Installed	VN
3377	14.0 LBS	6"	18"	II	1" Rotalock	Installed	VN
3378	19.3 LBS.	6"	24"	II	1" Rotalock	Installed	VN
3379	24.6 LBS	6"	30"	Ш	1" Rotalock	Installed	VN







File No. SA 2400 Vol. 1

ROTALOCK VALVES AND ADAPTERS

Horizontal Valves	Vertical Valves	Straight Adapters	Angle Adapters						
3/4" ROTALOCK VALVES AND ADAPTERS									
24474 - 1/4 " I.D. Sweat		24683 - 1/4" I.D. Sweat	24686 - 1/4" I.D. Sweat						
24475 - 3/8" I.D Sweat		24516 - 3/8 " I.D. Sweat	24515 - 3/8" I.D. Sweat						
	1" ROTALOCK VALV	/ES AND ADAPTERS							
27718 - 3/8 SAE Flare	27742 - 3/8 SAE Flare	24246- 3/8 I.D. Sweat	24957 3/8 SAE Flare						
27689 - 1/2 SAE Flare	27035 - 1/2 SAE Flare	24247 - 1/2 I.D. Sweat	24958 - 1/2 SAE Flare						
27691 - 5/8 SAE Flare	27036 - 5/8 SAE Flare	24248 - 5/8 I.D. Sweat	24959 - 5/8 SAE Flare						
23075 3/8 I.D. Sweat	24606 - 3/8 I.D. Sweat		24252 - 3/8 I.D. Sweat						
24601 - 1/2 I.D. Sweat	24490 - 1/2 I.D. Sweat		24253 - 1/2 I.D. Sweat						
24602 - 5/8 I.D. Sweat	24491 - 5/8 I.D. Sweat		24254 - 5/8 I.D. Sweat						
	1 1/4" POTALOCK VA	LIVES AND ADAPTERS							
24602 7/011 D Course	· · · · · · · · · · · · · · · · · · ·		24256 7/0 D. S						
24603 - 7/8" I.D. Sweat	24493 - 7/8" I.D. Sweat	24250 - 7/8" I.D. Sweat	24256 - 7/8" I.D. Sweat						
24325 - 1-1/8" I.D. Sweat	24494 - 1-1/8" I.D. Sweat	24251 - 1-1/8" I.D. Sweat	24257 - 1-1/8" I.D. Sweat						
TEFLON GASKETS									
	24590 - 3,	/4" Gasket							
	24591 - 1	1" Gasket							
	24592 - 1-2	1/4" Gasket							




ASME RECEIVERS FOR 600 P.S.I. (R410A)

These larger receivers are assembled by shielded arc weld construction. They are made to ASME code and marked with an attached metal tag. Rotalock connections of 1 1/4"-12 are used on these receivers for valves or fittings (not included) shown on page 15. +Part numbers 3110 and 3111 are supplied with 1"-14 Rotalock connections. A 1/2" pipe fitting is supplied for a pressure relief or a pop-off valve (not supplied). All parts are painted with epoxy powder coating. Working pressure for this product line is 600 p.s.i. maximum.


Welded mounting brackets are attached on the vertical models. Adjustable mounting brackets are also available for the horizontal models, but not included or attached to the part. RR7187 (8-5/8" Dia.); RR7188 (10-3/4" Dia.).

These special ASME receivers specifically designed for R410A refrigerant can be customized.

	*Pump		"B"		
Part	Down	"A"	Length	Horz. Or	Shipping
Number	Capacity	Diameter	Over Caps	Vert.	Wt.
3110+	17	8 5/8	12	Vert.	24
3111+	24	8 5/8	16	Vert.	29
3230	28	8 5/8	18	Vert.	38
3112	38	8 5/8	24	Vert.	41
3231	42	10 3/4	18	Vert.	60
3232	57	10 3/4	24	Vert.	72
3294	57	10 3/4	24	Vert.	72



	*Pump		"B"		
Part	Down	"A"	Length	Horz. Or	Shipping
Number	Capacity	Diameter	Over Caps	Vert.	Wt.
3113	45	8 5/8	28	Horz.	46
3233	59	8 5/8	36	Horz.	84
3114	69	8 5/8	42	Horz.	66
3236	81	8 5/8	48	Horz.	100
3238	94	10 3/4	36	Horz.	100



CE Rating available upon request.

Canadian Registration numbers issued for all provinces and territories in Canada upon Request

AVAILABLE 1 1/4" ROTALOCK VALVES AND FITTINGS FOR ABOVE RECEIVERS

Horizontal Valves 24603 – 7/8" I.D. Sweat 24325 – 1 1/8" I.D. Sweat

Vertical Valves 24493 – 7/8" I.D. Sweat 24494 – 1 1/8" I.D. Sweat Right Angle Adapters 24256 – 7/8" I.D. Sweat 24257 – 1 1/8" I.D. Sweat

Straight Adapters 24250 – 7/8" I.D. Sweat 24251 – 1 1/8" I.D. Sweat

Teflon Gasket No. 24592




^{*90%} at 90°F - 600 PSI Working Pressure

BIG DOG RECEIVER DRIERS

The Big Dog receiver-drier combines the Bull Dog receiver with the Bull Dog driers, both rated for 500 psi, into one component to save space and eliminate brazing joints. Eliminating brazing joints reduces the source of potential leaks in a system and decreases introduction of debris from brazing. The hydrogen copper brazed steel construction provides maximum strength and interior cleanliness.

The Big Dog receiver-drier comes standard with a sight glass, the only standard model available anywhere with this feature. The moisture indicating ring in the sight glass provides important feedback for both the liquid level and the system moisture.

The entire receiver can be isolated from the system by rotalock valves and easily replaced or removed for maintenance. The flow through drier portion provides twice as much drier capacity as standard model driers for greater moisture absorption and a longer life cycle.



The captivated loose fill desiccant provides greater area for maximum drying effectiveness and the receiver-drier is suitable for bi-flow when mounted in the horizontal position for flexibility of application.

CATALOG NUMBER	PUMP DOWN CAPACITY	SHELL DIAMETER "A"	OVERALL LENGTH "B"	NOMINAL TONS	ROTALOCK CONNECTION	· (!!) CODE IDENTIFIER
3135	2.5 lbs.	4"	10"	1/4 to 5	1"-14	KN
3136	7 lbs.	6"	12"	2 to 71/2	1"-14	MN
3137	12 lbs.	6"	18"	5 to 15	1"-14	MN



File No. SA 2401 Vol. 1


SHELL & COIL TYPE CONDENSER-RECEIVERS

These redesigned water cooled condenser-receivers are processed to insure cleanliness and reliability. Water circulates through a special finned copper coil. Capacities are conservatively rated.

The receivers are designed with refrigerant rotalock connections. This gives the installer the ability to rotate the position of the fittings on the receiver as he needs for installation. The receiver comes with a rotalock valve with a 3/8" sweat connection. Also included is an angle adapter with 3/8" SAE flare connection. However, when ordering the condenser, if a different valve or adapter is needed, they may be exchanged for a different one as shown in chart below.

All condenser-receivers are complete with our "Leek Pruf" fusible plug and welded mounting brackets. All are pressure tested and UL listed for reliability and all are powder coated for corrosion protection.

The charts and diagrams below show dimensions and specifications.



PART	+	OUTLET	INLET	WATER	**RECEIVER	(J.)	WEIGHT			
NO.	TONS	ROTALOCK CONNECTION	ROTALOCK CONNECTION	CONNECTION	PUMP DOWN CAPACITY	CODE	Α	В	С	D	E	(LBS.)
5803	1/2	3/4"	1"	1/2" NPT Fem. Flare	7 lbs.	ON	14	5	7-1/2	2-1/2	3	18
5806	3/4	1"	1"	1/2" NPT Fem. Flare	11 lbs.	FN	14	6	7-1/2	4-1/4	3-3/16	22
5802	1	1"	1"	1/2" NPT Fem. Flare	14 lbs.	FN	16-1/4	6	7-1/2	4-1/4	3-3/16	26
5804	1-1/2	1"	1"	1/2" NPT Fem. Flare	19 lbs.	FN	23-7/8	6	17-1/4	4-1/4	3-3/16	30

**90% AT 90° for R22 and R502 - For R12 and R134a multiply by 1.1 - For R402b and R404a multiply by 0.9 \dagger Tons rating for 105°F condensing temperature



File No. SA 2400 Vol. 1





COAXIAL CONDENSERS

Coaxial water cooled condensers of various configurations are available as shown below. These counterflow condensers provide good performance at a minimum cost. Cataloged or special receivers up through 6" diameter can be provided for use with these condensers as a package for convenient hook-up. Inquiries for special runs are welcomed. All coaxial condensers come complete with brackets.

(CE) marking available upon request.



File No. SA 6300

PART	TONS	REFRIGERANT	CONNECTIONS	CONNECTIONS WATER CONNECTIONS (LL DIME	NSIONS	WEIGHT	UL CODE
NUMBER	TONS	IN	OUT	IN	OUT	Н	L	W	(LBS.)	OF CODE
5027-S	1/3	3/8" I.D.	3/8" I.D.	1/2" I.D.	1/2" I.D.	3"	9-1/4"	6-1/2"	3	CC033
5028-S	1/2	3/8" I.D.	3/8" I.D.	1/2" I.D.	1/2" I.D.	3-7/8"	9-1/4"	6-1/2"	5	CC050
5022-S	3/4	3/8" I.D.	3/8" I.D.	1/2" I.D.	1/2" I.D.	4-3/4"	9-1/4"	6-1/2"	10	CC075
5023-S	1	3/8" I.D.	3/8" I.D.	1/2" I.D.	1/2" I.D.	5"	11"	8-1/2"	12	CC100
5024-S	1-1/2	3/8" I.D.	3/8" I.D.	5/8" I.D.	5/8" I.D.	4-1/4"	11-3/4"	10"	14	CC150
5025-S	2	1/2" I.D.	1/2" I.D.	5/8" I.D.	5/8" I.D.	5-1/4"	11-3/4"	10"	17	CC200
5026-S	3	1/2" I.D.	1/2" I.D.	5/8" I.D.	5/8" I.D.	6-1/2"	12-7/8"	12"	27	CC300
8267-S	1	1/4" S.A.E. FLARE	1/4" S.A.E. FLARE	1/2" I.D.	3/8" N.P.T	8"	11"	7-3/4"	11	ATCC100
8268-S	2	1/4" S.A.E. FLARE	1/4" S.A.E. FLARE	1/2" I.D.	3/8" N.P.T	9-3/4"	11"	7-3/4"	16	ATCC200

S-steel outer tube with copper inner tube Copper outer tube available on special order Dimensions subject to change without notice

DOUBLE WALL CLEANABLE

DESUPERHEATING HEAT EXCHANGERS

These practical double wall desuperheating heat exchangers are of non-ferrous construction and provide a new standard of flexibility and convenience.

They are for use where local codes call for double wall type heat exchangers. The entire inner surface is quickly cleaned of water deposits with a wire brush by removing screw caps and standard washers. There are no bolts and gaskets to remove.





PART NUMBER	SYSTEM	MAX. BTU/HR. HEATED	MAX. GAL. TO BE HEATED 100°F	HORIZONTAL TUBES	HEIGHT INCHES	LENGTH INCHES	WEIGHT LBS.
	1 ton	2400	2.9	1	4.5"	37"	4
5969	2 ton	4800	5.8	1	4.5"	37"	4
5975	3 ton	7200	8.7	2	10.5"	37"	9
5976	5 ton	12,000	14.4	3	14.5"	37"	14
5977	7 1/2 ton	18,000	21.5	4	18.5"	37"	19
5978	10 ton	24,000	29.0	5	22.5"	37"	24



DESUPERHEATING HEAT EXCHANGERS

SUPERHEATED REFRIGERANT GAS TO WATER

(For commercial refrigeration, heat pumps, milk coolers, air conditioning, etc.)

For many years it has been known that the commercial refrigeration compressor can be used to provide an abundance of water at 150°F (or even 180°F) while at the same time doing its intended refrigeration job and at a saving of perhaps 8 to 10% of the electrical power it would normally use.

This is accomplished by installing a heat exchanger designed for interchange of heat between superheated refrigerant gas and water. SUCH A SYSTEM PROVIDES ONE OF THE MOST CERTAIN WAYS OF SAVING AN APPRECIABLE AMOUNT OF ENERGY AND AT COMPARATIVELY LOW INVESTMENT COST.

The heat exchanger is installed in the discharge line between the commercial refrigeration compressor and condenser, whether the condenser is of the water or air cooled type. The heat exchanger is designed to pick up not over 25% of the total rated load of the condenser.

In an ordinary commercial refrigeration system, about 30% of the work of the condenser is in reducing the superheated gas temperature to the condensing temperature. The balance of the work of the condenser is in condensing the gas to liquid and sub-cooling it.


Therefore, if the above mentioned heat exchanger is designed to pick up only the heat of the superheat, it is assured that only high temperature water will be provided. At the same time if the existing water or air cooled condenser does not have to handle the heat of superheat, it has additional capacity and the condensing temperature and pressure will drop causing the compressor to require less power.

Oversizing the heat exchanger would, of course, cause it to act somewhat as a water cooled condenser and the temperature of the water to be heated would be much lower.

With the addition of this type of heat exchanger, it is also advisable to add an insulated hot water storage tank of ample capacity.

Usually these heat exchangers should be installed on commercial systems using automatic or thermostatic expansion valves. Installation must always be made by a qualified refrigeration service engineer. If installation is made on a capillary fed system, it should be under the direction of a refrigeration engineer having knowledge of capillaries.

			REFRIG.	MAX. BTU/HR.	MAX. GALS.			
	REFRIGERATION	WATER LINE	GAS LINE	FOR WATER	TO BE HEATED	SHELL	LENGTH	WEIGHT
PART No.	TONS	OPENING	OPENING	HEATER	50°TO 150°/HR.	DIA.	IN.	LB.
5836	3	5/8	5/8	7200	8.7	5	9	11.0
5837	5	5/8	7/8	12000	14.4	5	13	15.0
5838	7 1/2	5/8	1-1/8	18000	21.5	5	18	20.0
5839	10	5/8	1-3/8	24000	29.0	5	23	25.0

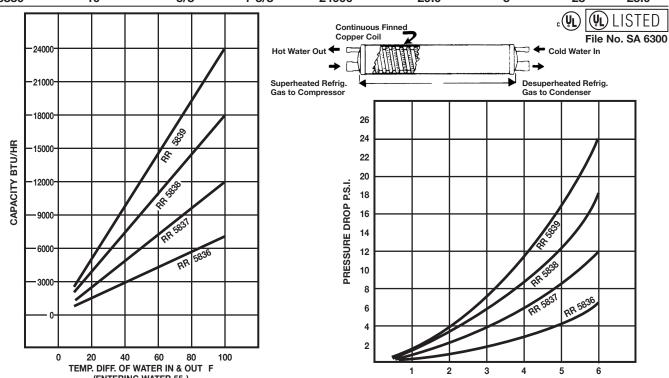

Desuperheating Heat Exchangers of smaller sizes are available on special request.



Blue Ribbon Heat Exchangers are <u>particularly suited for suction cooled compressor applications</u>. They are of all copper construction and incorporate a special expansion process providing positive contact between tube and body. Fittings are sized for standard units for 1/4 through 10 h.p., eliminating the need for adapter fittings. The Blue Ribbon series offer quality and high efficiency - at low competitive prices.

CATALOG NUMBER	H.P.	OVERALL LENGTH	SHELL O.D.	LIQUID LINE OPENING	SUCTION LINE OPENING	WEIGHT LBS.
BH 33	1/4 & 1/3	8	7/8	1/4	3/8	.6
BH 50	1/2	11	7/8	1/4	1/2	.8
BH 75	3/4	14	7/8	1/4	5/8	1.0
BH 100	1	15	7/8	3/8	5/8	1.5
BH 150	1-1/2	11	1-3/8	3/8	7/8	2.0
BH 200	2	13	1-3/8	3/8	7/8	2.0
BH 300	3	15	1-3/8	1/2	1-1/8	2.1
BH 500	5	15	2	1/2	1-1/8	2.3
BH 750	7-1/2	15	2	5/8	1-5/8	2.5
BH 1000	10	18	2	5/8	1-5/8	2.7

File No. SA 6300 (VL) VL LISTED

DELUXE SUBCOOLING HEAT EXCHANGERS




Deluxe series Heat Exchangers are designed to provide a <u>maximum of heat transfer efficiency</u> with a minimum of pressure drop. They are conservatively rated in horsepower and therefore easy to select for a particular application.

Installation is simplified as connections are of proper size to match suction and liquid lines of standard units. Installation is neat as fittings are in the end caps and lines remain parallel.

Deluxe Heat Exchangers are of steel and copper construction. All heat exchangers are carefully leak tested under high pressure.

CATALOG NUMBER	H.P.	SHELL O.D. (B)	OVERALL LENGTH (E)	SUCTION LINE (C)	LIQUID LINE (D)	WEIGHT LBS.
H 33	1/4 & 1/3	2	8-5/8	3/8	1/4	.8
H 50	1/2	2	10	1/2	1/4	1.3
H 75	3/4	2	12-1/8	5/8	1/4	1.7
H 100	1	2	13-1/8	5/8	3/8	1.9
H 150	1-1/2	2	17-3/8	7/8	3/8	2.5
H 200	2	3	13-1/4	7/8	3/8	3.1
H 300	3	3	15-1/4	1-1/8	3/8	3.8
H 500	5	5	14-3/8	1-1/8	1/2	7.0
H 750	7-1/2	5	15-5/8	1-5/8	5/8	9.0
H 1000	10	5	18-5/8	1-5/8	5/8	11.0



File No. SA 6300

CE Documentation upon request.



OIL RESERVOIRS

These reservoirs may be used with the oil separator and an oil level regulator to return oil to the compressor.


PART	"A"	"B"	TOTAL	LENGTH	UL CODE
NUMBER	CAPACITY	CAPACITY	CAPACITY	LENGIA	OF CODE
5014	.75 gallon	.75 gallon	2 gallon	18"	MN
5014-1	.75 gallon	3 gallon	4 gallon	36"	MN

Rated for 500 PSI.



Total

Oil Reservoirs are necessary on multiple, parallel compressor systems. They act as a holding vessel ready to feed oil to the oil level regulators as needed to maintain the proper oil level at each individual compressor and are essential for



OIL LINE STRAINERS

The Oil Line Strainer prevents dirt and contaminants from entering the oil level regulator and the crankcase of the compressor.


Part No.	Inlet	Outlet	Screen Area	Screen Material	Overall Length
8671	3/8 Male	3/8 Male	11	100 Mesh	4 7/8"
	Flare	Flare		Monel	

HEAT EXCHANGERS LIQUID TO LIQUID

These heat exchangers have been produced for many years by our Solar Research Division for use to provide heat interchange between liquid circulating from solar collectors and water in a storage tank. These can be used for other applications where a liquid to liquid heat exchange is needed.

A continuous copper coil runs through the heat exchanger eliminating all internal joints. A steel tube casing encloses the coil and an internal steel baffle slows the surrounding liquid inside the casing for maximum heat transfer.

CURVES BASED UPON WATER ENTERING COUNTERFLOW AT 150°F AND 55°F

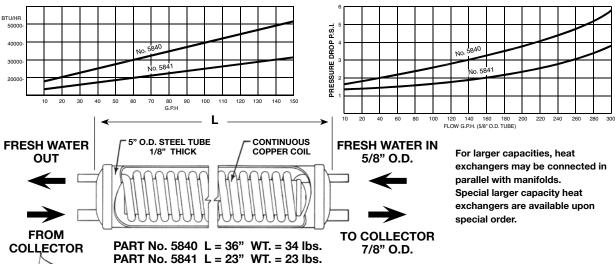

OIL SEPARATORS


FOR INCREASED EFFICIENCY AND ... ENERGY SAVINGS


REFRIGERATION RESEARCH. INC. offers oil separators for either single or multiple (parallel) compressor systems. All of these separators are hydrogen copper brazed and pressure tested to assure cleanliness and reliability.

The oil separators listed below contain an internal mechanical float to provide the return of oil to the crankcase of the compressor or the oil reservoir. A chart of special models below are for use for R-410A refrigerant.

		IMENSIONS	LINE	SIZE		CAPA	CITY IN TONS	OF REFRIGER	ATION			
PART NUMBER		IIVIENSIONS	DISCHARGE	OIL RETURN	R-12,	R-12, R-134a		R-22, R-407C, R-502		A, R-507		
	Α	В	LINES LINE		EVAPORATOR TEMP.		EVAPORATOR TEMP.		EVAPORATOR TEMP.		OIL PRECHARGE (oz.)	UL CODE
					-40°F	+40°F	-40°F	+40°F	-40°F	+40°F		
8399	4	7 3/4	3/8	3/8	0.8	1.0	1.0	1.5	1.0	1.5	20	KN
8408	4	9 3/4	1/2	3/8	1.0	1.5	1.5	2.0	1.5	2.0	20	KN
8409	4	14	5/8	3/8	3.0	4.0	4.5	5.5	4.0	5.5	20	KN
8410	4	17	3/4	3/8	4.0	5.0	5.5	6.5	5.5	7.0	20	KN
8411	6	12	7/8	3/8	4.5	5.5	7.0	8.0	6.5	8.5	50	MN
8412	6	13 1/2	1 1/8	3/8	6.0	7.5	9.0	10.5	8.5	11.0	50	MN
8413	6	15 1/2	1 %	3/8	8.0	10.0	12.0	14.0	12.0	15.0	50	MN
8414	6	18	1 %	3/8	11.0	14.0	16.0	18.0	15.0	19.0	50	MN
8415*	6	19	2 1/8	3/8	18.0	21.0	25.0	30.0	24.0	31.0	50	MN

	_	IMENSIONS	LINE	SIZE		(TONS OF RATION)		
PART NUMBER	ľ	IIVIENSIONS	DISCHARGE	OIL RETURN	R-4	10A		
	Α	В	LINES	LINE	EVAPORA	TOR TEMP.	OIL PRECHARGE (oz)	UL CODE
					-40°F	+40°F		
8379	4	7 3/4	3/8	3/8	1.5	2.3	20	OSTN
8381	4	9 3/4	1/2	3/8	2.3	3.0	20	OSTN
8382	4	14	5/8	3/8	6.9	8.5	20	OSTN
8383	4	17	3/4	3/8	8.5	10.0	20	OSTN
8384	6	12	7/8	3/8	10.8	12.4	50	OSVN
8387*	6	13 1/2	1 1/8	3/8	13.0	16.0	50	OSVN
8388*	6	15 1/2	1 %	3/8	18.5	21.7	50	OSVN
8393*	6	18	1 %	3/8	24.8	28.0	50	OSVN
8394*	6	19	2 1/8	3/8	35.0	45.0	50	OSVN




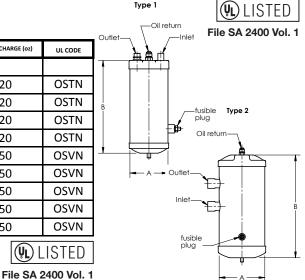

Mount all oil separators vertically. The smallest connection on the top, the 3/8" flare, returns the oil to the compressor or to the top of the oil reservoir as shown in diagram 1. Connect the discharge line from the

compressor to the nipple labelled "IN". The other nipple connects to the condenser.

Multiple (parallel) systems require oil level regulators attached to the crankcase of each individual compressor. Also, a pressure differential valve in a separate line from the oil reservoir to the common suction line regulates the pressure in the oil reservoir to prevent excessive pressure in the oil reservoir while still maintaining a positive pressure above the crankcase pressure.



SPECIAL O.E.M. PARTS

Refrigeration Research has made hundreds of special parts for original equipment manufacturers over many years. Many customers need similar parts for new products or replacements for repairs in the field. Below are a few receivers and suction accumulators which we now make available due to their popularity. These components are powder coated for a 500 hour salt spray test rating. Contact our engineering department for more component details.

Suction Accumulators

<u>Part No.</u>	<u>Description</u>	<u>Connections</u>
3488 (577-0421-01)	5" x 12"	1-1/4" Rotalock Inlet; 3/4" Sweat Outlet
3489 (577-0421-00)	6" x 13"	1-1/4" Rotalock Inlet; 7/8" Sweat Outlet
3656 (577-0286-01)	6" x 13"	7/8" Sweat Inlet; 1-1/4" Rotalock Outlet
7451 (577-0437-00)	6" x 13.5"	7/8" Sweat Inlet & Outlet with Sight Glass
7516	6" x 13.5"	7/8" Sweat Inlet & Outlet with Sight Glass

Receiver Replacements

Copeland Part No.	<u>Description</u>	R.R. Equivalent Part No.
077-C221-03	3" x 10" 1/4" in/out	5774
577-0435-00	3.5" x 10" 1/4" in/out	9017
077-C221-13	5" x 10" 3/8" in/out	5315
577-0019-00	5" x 10" 1/4" in/out	1918
577-0056-01	6" x 12" 3/8" in/out	6801
577-0420-01	6" x 20" 1/2" in/out	3212

Miscellaneous Receiver Replacement Parts

10.75" x 26" 1-3/8" in/out 3294

Contact Refrigeration Research, Inc. for additional cross reference items.







Filter-Driers In-Depth Filtration

With XH-11 Desiccant—Recommended by Desiccant Manufacturers for all Refrigerants and Lubricants

A large cylindrical inlet screen held by a strong spring keeps the desiccant securely in place. The inlet screen is designed to let some dirt particles through and become trapped in the maze of tightly held desiccant and the outlet filter. Therefore, this drier can collect considerably more dirt than one which collects dirt only on a surface.

All of the volume of desiccant in this drier is used efficiently to dry and clean the system since no binder is used. These driers are exceptionally high in acid removal capacity.

CATALOG NUMBER	FLARE FITTINGS	NOMINAL TONS	SHELL O.D.	OVERALL LENGTH	WEIGHT LBS.
T-032	1/4	1/4 – 1	2	4-7/16	.8
T-033	3/8	1/4 – 1	2	4-5/8	.8
T-052	1/4	1/3 – 2	2	5	1.0
T-053	3/8	1/3 – 2	2	5-1/8	1.0
T-083	3/8	1 – 4	2	5-7/8	1.2
T-084	1/2	1 – 4	2	6-1/4	1.21
T-163	3/8	2 – 5	3	6-1/2	1.57
T-164	1/2	2 – 5	3	6-7/8	1.58
T-304	1/2	3 – 71/2	3	9-7/8	2.3
T-305	5/8	3 – 71/2	3	10	2.31
T-414	1/2	5 – 10	3	10	3.2
T-415	5/8	5 – 10	3	10-1/8	3.2

The above driers provide interchangeability with other driers for convenience in service and they are available with pressure taps by special order.


(씨 LISTED

File No. SA 2401 Vol. 1



"THE INDUSTRY'S MOST COMPLETE LINE **OF QUALITY STRAINERS"**

A wide selection of highest quality strainers is available for all applications. All joints are hard soldered or copper hydrogen brazed. Each strainer is individually tested under high pressure. Type FG and FH strainers contain 150 mesh monel screen. All other strainers contain screen of 100 mesh monel or stainless steel. All stainers below have cylindrical screens and copper shells except FA, FC, and FD which have steel shells. All U.L. recognized, U.L. listed upon request.

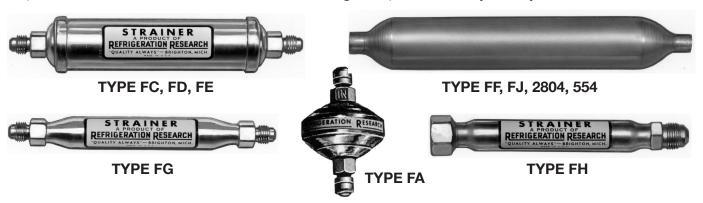

TYPE NUMBER	SQ. IN. SCREEN AREA	INLET	OUTLET	SHELL O.D.	OVERALL LENGTH	WEIGHT LBS.
FE 14	9	1/4 Flare	1/4 Flare	1-1/4	6-3/8	.4
FE 16	9	3/8 Flare	3/8 Flare	1-1/4	6-3/8	.4
FE 24	12	1/4 Flare	1/4 Flare	1-1/4	7	.5
FE 26	12	3/8 Flare	3/8 Flare	1-1/4	7-1/4	.5
FF 14	6	1/4 Sweat	1/4 Sweat	1-1/4	4-5/8	.3
FF 16	6	3/8 Sweat	3/8 Sweat	1-1/4	4-5/8	.3
FF 24	9	1/4 Sweat	1/4 Sweat	1-1/4	5-5/8	.4
FF 26	9	3/8 Sweat	3/8 Sweat	1-1/4	5-5/8	.4
FG 4	3.5	1/4 Flare	1/4 Flare	3/4	6	.2
FG 6	3.5	3/8 Flare	3/8 Flare	3/4	6-1/4	.3
FH 4	3.5	1/4 Fem. Flare	1/4 Flare	3/4	6	.2
FH 6	3.5	3/8 Fem. Flare	3/8 Flare	3/4	5-3/4	.3
FJ 14	5.8	1/4 Sweat	1/4 Sweat	3/4	5-3/4	.2
FJ 16	5.8	3/8 Sweat	3/8 Sweat	3/4	5-3/4	.2
FJ 18	5.8	1/2 Sweat	1/2 Sweat	3/4	5-3/4	.2
FJ 20	5.8	5/8 Sweat	5/8 Sweat	3/4	5-3/4	.2
FA 4	3.0	1/4 Flare	1/4 Flare	2	3-1/2	.5
FA 6	3.0	3/8 Flare	3/8 Flare	2	3-3/4	.5
FA 8	3.0	1/2 Flare	1/2 Flare	2	4	.6
FC 4	12	1/4 Flare	1/4 Flare	2	5-1/2	.8
FC 6	12	3/8 Flare	3/8 Flare	2	5-3/4	1.0
FC 8	12	1/2 Flare	1/2 Flare	2	6	1.2
FD 4	30	1/4 Flare	1/4 Flare	2	9-1/2	1.3
FD 6	30	3/8 Flare	3/8 Flare	2	9-3/4	1.4
FD 8	30	1/2 Flare	1/2 Flare	2	10	1.5
FD 10	30	5/8 Flare	5/8 Flare	2	10-1/2	1.7
2804-1	24	7/8 Sweat	7/8 Sweat	2	8-3/8	.6
2804-2	24	1-1/8 Sweat	1-1/8 Sweat	2	8-3/8	.6
2804	24	1-3/8 Sweat	1-3/8 Sweat	2	8-3/8	.6
554-3	30	7/8 Sweat	7/8 Sweat	3	9-1/4	1.7
554-2	30	1-1/8 Sweat	1-1/8 Sweat	3	9-1/4	1.7
554-1	30	1-1/4 Sweat	1-1/4 Sweat	3	9-1/4	1.7
554	30	2-1/8 Sweat	2-1/8 Sweat	3	9-1/4	1.7



File No. SA 2401 Vol. 2 VL RECOGNIZED


ACCUMULATORS & ACCUMULATOR-DRIERS



All of the accumulators shown below have 1-5/8" diameter copper shells. Shell dimensions of the accumulator-driers are the same as the accumulators, the only difference being that the accumulator-driers contain our monel wire cloth desiccant bag of 22 grams of silica gel.

Part numbers shown below designate accumulator-driers. *If an accumulator only is desired, this must be specified when ordering by adding an "A" to the part number.

Accumulators and accumulator-driers may be mounted slightly inclined, horizontally or vertically.



PART NUMBER	"A" I.D.	"B" I.D.	"C" LENGTH	WEIGHT LBS.
620	3/8	3/8	12	.8
621	3/8	1/2	12	.8
622	1/2	1/2	12	.8
623	1/2	5/8	12	.8
624	3/8	3/8	9	.6
625	3/8	1/2	9	.6
626	1/2	1/2	9	.6

MANIFOLDS


Illustrated are Type 1 and Type 2 Manifolds manufactured by Refrigeration Research. They are of copper construction and fit most applications.

TYPE 1

PART NUMBER	A	В	С	D
693	3/8 ID	1/8 ID	1/8 ID	
701	3/8 ID	1/4 ID	1/4 ID	
707	5/16 ID	3/32 ID	3/16 ID	
709	1/2 ID	1/8 ID	1/8 ID	
712	1/2 ID	3/4 ID	3/4 ID	

		TYPE 2		
694	3/8 ID	1/8 ID	1/8 ID	1/8 ID
708	5/8 OD	3/16 ID	3/16 ID	3/16 ID
716	7/8 ID	1/2 ID	1/2 ID	1/2 ID
718	1-1/8 ID	5/8 ID	5/8 ID	5/8 ID
727	1/2 OD	5/16 ID	5/16 ID	5/16 ID

TVDE

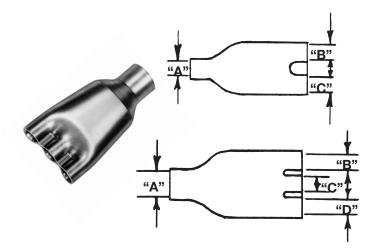



UNIVERSAL DRIERS

Both Universal Driers shown on this page were designed to fulfill a definite need for the Service Engineer. Both save unnecessary and expensive trips because they provide adaptable sweat connections. Both driers are adequate for systems up through one (1) hp. Especially important, all driers are hermetically sealed to stay fresh indefinitely.

EXCLUSIVE UNIVERSAL BIG R DRIER FOR SYSTEMS THROUGH 1hp.



Catalog NO. 3068

- ☐ With Desiccant-Recommended by Desiccant Manufacturers for all Refrigerants and Lubricants.
- BUDGET PRICED and made of ONE PIECE OF COPPER.
- ☐ STAYS DRY INDEFINITELY -NO PLASTIC CAPS-Hermetically sealed.
- ☐ Cut tube for 3/8" or 1/4" diameter–Form capillary sizes with pliers.
- ☐ Contains high capacity molecular sieve desiccant. (For systems up to 1 hp)
- □ BASKET OUTLET provides large area resulting in smaller pressure drop.

PAT. NO. 3,656,625

DELUXE UNIVERSAL DRIER

Catalog NO. 2933

WITH XH-11 DESICCANT

FOR SYSTEMS THROUGH 1hp.




Made of three pieces of copper. Provides features of the BIG R plus additional tubing sizes.

For 5/16, 1/4 or 3/16 O.D. tubing cut the connector attached to the drier at the correct place as indicated in the photo above.

For a 3/8 I.D. simply unsolder and remove the adapter from the drier. This will allow 3/8 O.D. tube to be quickly and easily installed to the drier.


For capillary sizes cut the 3/16 I.D. tube where indicated, then pinch tube down to fit the particular size of capillary.

For systems up through 1 H.P. Drier is 1" O.D. and has overall length of 9 inches.



2003 CAPILLARY STRAINER-DRIER

ASSEMBLIES

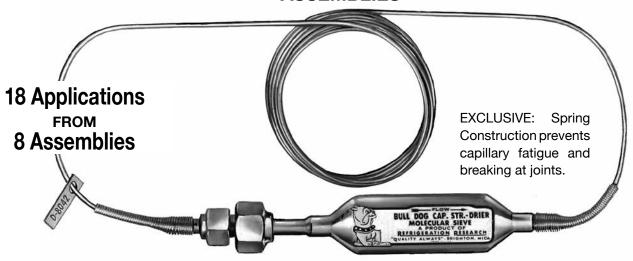

These Capillary Strainer-Drier Assemblies containing XH-11 molecular sieves are intended for use on the high side. Adequate desiccant capacity has been provided and a fine mesh outlet basket type strainer protects the capillary tube against plugging.

2	Evaporator Temperature				
Compressor Horsepower	Low	Medium	High		
1/10 - 1/9 -1/8	A-16031	B-8031	C-8036		
1/6 - 1/5	B-8031	C-8036	D-8042		
1/3 - 1/4	C-8036	D-8042	E-10050		
1/2	D-8042	E-10050	F-8055		
3/4	E-10050	F-8055	G-8070		
1	F-8055	G-8070	H-7080		

Capillary Strainer-Drier Assemblies are graduated according to the same uniform pattern as the Capillary Strainer-Assemblies on the following page. The numbers differ only in that an extra "0" has been added between the two groups of indicating numbers. Individual metal tag positively identifies bore of capillary.

Drier inlet fitting is 1/4 SAE female and capillary outlet is provided with a 1/4 SAE male fitting. 3/8 SAE fittings available on special order.


JUNIOR DRIER FOR SYSTEMS THROUGH 3/4 hp. Catalog NO. 2948



This drier contains adequate XH-11 molecular sieve desiccant for units up through 3/4 H.P. and is permanently sealed against moisture for storage. Diameter is one inch and overall length nine inches. A 1/4" diameter copper tube at each end may be cut off, formed or sized as required. Large basket type outlet strainer is provided.



EXAMPLE STRAINER-ASSEMBLIES

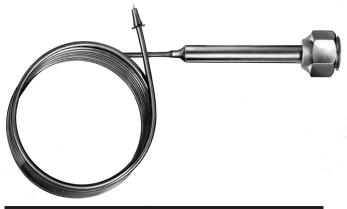

Compressor	Evaporator Temperature					
Compressor Horsepower	Low	Medium	High			
1/10 - 1/9 - 1/8	A-1631	B-831	C-836			
1/10 - 1/9 - 1/6	A-1031	D-03 I	C-030			
1/6 - 1/5	B-831	C-836	D-842			
1/3 - 1/4	C-836	D-842	E-1050			
1/2	D-842	E-1050	F-855			
3/4	E-1050	F-855	G-870			
1	F-855	G-870	H-780			

18 Applications 8 Assemblies

Capillary Strainer Assemblies have oversized monel strainer elements of 150 mesh screen for maximum filtration and dirt retention. They have been engineered to provide accurate refrigerant metering for specific applications without field adjustment or cutting.


Assemblies are graduated according to a uniform pattern with "A" having the highest filtration, then "B" "C", etc., through "H", which has the lowest restriction of all. The first number or numbers following the letter indicate the capillary tube length in feet–the last two numbers indicate the inside diameter of the capillary tube in thousandths of an inch.

Inlet fitting is supplied with 3/8" brass flare nut.

CAPILLARY STRAINERS

Illustrated are capillary strainers which are most common in refrigeration use. Construction is copper with monel cloth strainer.

PART NUMBER	OVERALL LENGTH "A"	"B" ID	"C" ID	TUBE O.D.
2076	3	.253257	.127131	3/8
2611	2-1/4	.190194	.083087	1/4
2612	2-1/4	.190194	.087091	1/4
2613	2-1/8	.253257	.087091	5/16
2632	2-1/8	.253257	.101105	5/16



CAPILLARY TUBING

Capillary tubing listed below is of uniform plug drawn quality. Shipped in coils of approximately 100 ft.

CATALOG NUMBER	I.D.	O.D.	APPROX. WT. PER 100' COIL
03181	.031	.081	1.7
03687	.036	.087	1.9
04293	.042	.093	2.0
04999	.049	.099	2.2
04925	.049	.125	3.9
05525	.055	.125	3.8


CATALOG NUMBER	I.D.	O.D.	APPROX. WT. PER 100' COIL
06025	.060	.125	3.6
06425	.064	.125	3.5
07025	.070	.125	3.3
08040	.080	.140	4.0
08545	.085	.145	4.2
09050	.090	.150	4.4

Tolerance = \pm /- .002 on O.D.; \pm /- .001 on I.D.



STRAINER ELEMENTS


The following are a few of the more popular special strainer elements supplied to O.E.M. accounts in quantities. These strainer elements may be pressed into tubes or can be furnished in cartridges as shown below. PRICES AVAILABLE ONLY ON SPECIAL QUOTATIONS AND IN QUANTITIES.

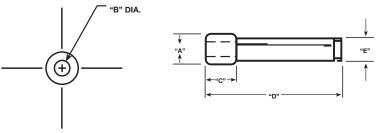

STR. NO.	TO PRESS INTO A TUBE OF	A	В	С	D	E	APPROX. AREA	BINDING
161	3/8 x .032	.311313	.121123	1/4	1-1/4	1/4	.7	Machined Brass
2586	3/4 x .035	.685688	.430	1/2	3-5/8	9/16	6.0	Stamped
178	1 x .035	.936939	.687	1/4	1-9/16	3/4	3.0	Stamped
2487	1 x .035	.936939	.687	1/4	2-1/2	3/4	6.0	Stamped
179	1-1/4 x .035	1.187 - 1.189	.812	5/16	3-5/8	7/8	9.0	Stamped
2582	1-1/4 x .035	1.187 - 1.189	.812	5/16	4-5/8	7/8	12.0	Stamped
2587	2 x .035	1.934 - 1.936	1.437	5/16	2-5/8	1.50	12.0	Stamped
2588	2 x .035	1.934 - 1.936	1.437	5/16	6-1/2	1.50	30.0	Stamped

CARTRIDGE OR PENCIL TYPE STRAINERS

These strainers, made from copper tubing, contain strainer elements shown above. Several hundred special assemblies may be made from the combinations below and general types only are illustrated. ADDITIONAL CUSTOMER INFORMATION IS REQUIRED TO DEFINE A PARTICULAR STRAINER. QUOTATIONS ARE MADE ONLY UPON SPECIAL APPLICATION AND IN PRODUCTION QUANTITIES.

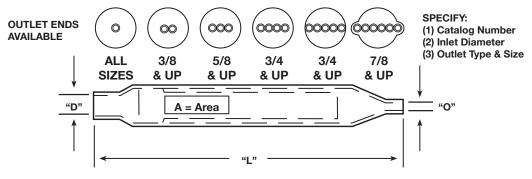

Clearance is allowed to provide proper fit for nominal capillary or tube sizes.


TYPE	CARTRIDGE OD & WALL	CAT. LGTH. "L"	STRAINER ELEMENT NO.	STRAINER ELEMENT AREA	Screen Mesh	BINDING	INLET ID's † AVAILABLE "D"	OUTLET ID's † "O"
37B	3/8 x .032	3	161	.7	150	Machined Brass	3/16, 1/4, 5/16 & 3/8	
75S	3/4 x .035	3-5/8	4764	3	100	Stamped	1/4, 3/8, 1/2, 5/8, & 3/4	standard
75SL	3/4 x .035	5-7/8	2586	6	100	Stamped	1/4, 3/8, 1/2, 5/8, & 3/4	cap
100S	1 x .035	3-5/16	178	3	100	Stamped	1/4, 3/8, 1/2, 5/8, & 3/4	
100SL	1 x .035	5-1/4	2487	6	100	Stamped	1/4, 3/8, 1/2, 5/8, & 3/4	
125S	1-1/4 x .035	5-5/16	179	6	100	Stamped	3/8, 1/2, & 5/8	
125L	1-1/4 x .035	6-1/2	177	9	100	Stamped	3/8, 1/2 & 5/8	
200S	2 x .035	6-1/2	2587	12	100	Stamped	3/8, 1/2 & 5/8	
200SL	2 x .035	10	2588	30	100	Stamped	3/8, 1/2 & 5/8	

† NOMINAL

OUTLETS AVAILABLE FOR STANDARD CAPILLARY.







REFRIGERATION RESEARCH

525 North Fifth Street • P.O. Box 869 Brighton, Michigan 48116

Phone: (810) 227-1151 FAX: (810) 227-3700

WEBSITE: www.refresearch.com

SUCTION MUFFLER

These mufflers smooth out suction pulsations resulting in reduced system noise when installed at the compressor on the <u>suction</u> side. They are of hydrogen copper brazed steel construction for maximum strength and complete cleanliness with copper nipples for ease of installation.



PART NUMBER	TONS	OVERALL LENGTH	FITTING SIZE	WEIGHT (LBS.)	UL CODE
1677	4-1/2 to 5	6-1/8	7/8" I.D. (IN) 7/8" I.D. (OUT)	1	SM-088
1678	6 to 10	6-1/8	1-1/8" I.D. (IN) 1-1/8" O.D. (OUT)	1	SM-113
1679	7-1/2 to 12-1/2	6-1/8	1-3/8" I.D. (IN) 1-3/8" I.D. (OUT)	1	SM-138

All mufflers are in accordance with $(\c V_L)$ and $\c (\c V_L)$ requirements. Rated for 450 PSI

(LISTED

File No. SA 3089





PRODUCTS:

- Accumulators
- Accumulator Driers
- Capillary Assemblies
- Chillers
- Condensers
- Driers
- Fusible Plugs
- Heat Exchangers
- Manifolds

- Mufflers
- Oil Reservoirs
- Oil Separators
- Receivers
- Sight Glasses
- Strainers
- Suction
 Accumulators

Refrigeration Research, Inc.



Refrigeration Research, Inc. 525 North Fifth St. Brighton, MI 48116 810-227-1151 www.refresearch.com